

North Eastern Regional Power Committee

Agenda For

34th PCC Sub-Committee Meeting

Time of meeting : 10:00 Hrs.

Date of meeting : 16th June, 2015 (Tuesday)

Venue : "Hotel Nandan", Guwahati.

A. CONFIRMATION OF MINUTES

CONFIRMATION OF MINUTES OF 33rd MEETING OF PROTECTION SUB-COMMITTEE OF NERPC.

The minutes of 33rd meeting of Protection Sub-committee held on 19th May, 2015 at Guwahati were circulated vide letter No. NERPC/SE (O)/PCC/2015/4520-4555 dated 04th June, 2015.

No observations or comments were received from the constituents. The Sub-committee may discuss & confirm minutes of 33rd PCCM of NERPC.

ITEMS FOR DISCUSSION

A.1 Implementation of 3-phase Auto Reclosure Scheme in all lines connected to Khandong and Kopili HEP:

For reliable operation of Power system it is required to implement 3-Phase Auto Reclosure Scheme in all the 132kV lines connected to Kopili and Khandong HEP of NEEPCO. The lists of such lines are:

- a) 132kV Khandong – Umrangso - Haflong
- b) 132kV Kopili – Khandong # 1

During 32nd PCC meeting, the sub-committee decided that at Khandong end it should be kept as check synchronization mode and at Khilehriat (PG) end it should be made as dead line charging mode. The Sub-committee requested NERTS and NEEPCO to co-ordinate amongst them and implement the 3-Phase Auto-reclosure at the earliest.

During 33rd PCC meeting, the sub-committee requested Assam, NERTS & NEEPCO to co-ordinate amongst them and implement the 3-Phase Auto-reclosure by 15.06.15 and the status should be intimated in the next PCC meeting. Assam, NERTS and NEEPCO agreed.

Assam/NEEPCO/NERTS may kindly intimate the status.

A.2 Implementation of 3-Phase Auto Reclosure Scheme of Radially fed 132kV Lines connected to Ranganadi HEP:

At present, the power flows to Nirjuli, Gohpur and Ziro radially from Ranganadi HEP and any transient fault in line causes undesirable outages. Hence, to avoid outages during transient fault it is essential to implement 3- Phase Dead Line charging of following 132kV Lines.

- a) 132kV Ranganadi – Nirjuli Line (Dead Line Charging at RHEP)
- b) 132kV Nirjuli – Gohpur Line (Dead Line Charging at Nirjuli)
- c) 132kV Ranganadi – Ziro Line (Dead Line Charging at RHEP)

During 33rd PCC meeting, EE, SLDC, Ar. Pradesh requested NEEPCO to intimate their plan atleast one week in advance so that necessary action can be taken by them.

The sub-committee requested NEEPCO to take up the matter with Ar. Pradesh so that SPAR on above lines could be completed.

NEEPCO/Ar. Pradesh may kindly intimate the status.

A.3 Implementation of the recommendations of the Protection Audit:

As per Sl. no 9.1.1 & 9.1.4 of Report on Enquiry Committee on Grid Disturbance in Northern Region on 30th July 2012 and in Northern, Eastern & North-Eastern Region on 31st July 2012, thorough Third Party protection audit needs to be carried out periodically along with independent audit of Fault Recording Instruments.

As decided in 32nd PCCM, all the constituents are requested to furnish the data as per check list of Task force in **Annexure A.3(II)** and the data as per format of NERPC in **Annexure A.3(I)** for future reference.

AEGCL have furnished check list of protection objects. AEGCL are requested to confirm whether these protection objects are applicable for all transmission elements owned by them and also requested to furnish details as per format of NERPC. All the other constituents are requested to furnish the details as early as possible.

During 32nd PCC meeting, the sub-committee had also requested NERPC to hold the special meeting to finalize the standard scheduling of O&M comprising of NERLDC, NERTS, NERPC, NEEPCO, Assam & Meghalaya etc., at the earliest so that the best O&M practices can be evolved in the region.

During 33rd PCC meeting, SE(O) informed that since there were other issues to be discussed along with above agenda, the meeting could not be held in May, 2015. The above meeting as suggested by the Sub-committee will be conducted soon by NERPC.

DGM (SO-II), NERLDC informed that information have been received from AEGCL (as per format II & Details of Protection Audit not received as per format-I), OTPC (as per format II), NEEPCO (Khandong & Kopili as per format-I). He requested the remaining constituents to submit at the earliest.

The sub-committee requested NERPC to write a letter to remaining constituents (i.e. NERTS (POWERGRID), NTPC, NHPC, NEEPCO (except Khandong & Kopili), AEGCL (for Details of Protection Audit as per format II), APGCL, MePTCL, MePGCL, MSPCL, DOP, Mizoram, DOP, Nagaland, DOP, Arunachal Pradesh, TSECL) to furnish the data as per check list of Task Force in Annexure – A.3 (II) and well as the data as per format of NERPC in Annexure A.3 (I) at the earliest.

NERPC has written to above constituents to furnish the data as per Annexure – A.3 (II) as well as Annexure – A.3 (I) and the reply is awaited.

Constituents may kindly intimate the status.

A.4 Standardization of Disturbance Recorder Channels:

Disturbance Recorders on Transmission elements are necessary for post disturbance analysis, and identification & rectification of any protection mal-operation. As per CBIP's manual on Protection of Generators, GT, Transformers and Networks, it is recommended to have minimum 8(eight) analog signals and 16(sixteen) binary signals per bay or circuit. Also, it should have a minimum of 5 sec of total recording time, minimum pre-fault recording time of 100 msec and minimum post-fault recording time of 1000 msec.

During 33rd PCC meeting, Manager (AM), NERTS informed that standardization for transformers & reactors are being finalized by their Corporate Centre for the whole country, the report would be circulated as soon as it is received from them. He also informed that suggestion by GM, NERLDC for NER States have already been communicated by them. He stated that as soon as the report is received they will intimate to NERPC/NERLDC accordingly.

NERTS may kindly intimate the current status.

A.5 Submission of formats for charging/first time synchronization of new elements:

Information related to charging/first time synchronization of new elements/units is to be furnished to NERLDC (two month in advance). All the activities related to charging/first time synchronization of new elements are to be completed before charging/first time synchronization of new elements. The technical data of the elements are also necessary for preparation of Base Case for system study for NER system.

During the 108th OCC meeting, SE(O) informed that nomination from NTPC was received only recently, the above meeting could not be conducted. Now since the complete list of nodal officers is received, NERPC will arrange the meeting at the earliest.

NERPC may kindly intimate the current status about holding the special meeting comprising of nodal officers of constituents, NERLDC & NERPC as suggested by the Sub-committee.

A.6 Reporting of failure of equipment/towers of transmission lines to Standing Committee of Experts:

CEA vide letter dated 04.02.2015 has intimated that as per Section 73 of Electricity Act 2003, CEA is to carry out investigation of failure of substations/generating stations and failure of transmission line towers. Accordingly two Standing Committees have been constituted taking representation from academic institutes, Research Institutes like CPRI and utility to investigate the cause of failures:

- (a) Standing Committee of Experts to investigate the failure of Transmission line towers of 220 kV and above voltage level of Power utilities.
- (b) Standing Committee of Experts to investigate the failure of Equipments of 220 kV and above substations/Generating stations of power utilities.

In view of above, it is requested that all utilities may please report the incidences of failure immediately after occurrence of such failure to Chief Engineer (SE&TD), CEA with copy to NERPC.

The format for reporting the first hand information about the failure of equipment in substations/generating stations and failure of transmission line towers are attached at **Annexure – A.6**

During 32nd PCC meeting, Meghalaya representative stated that Recent failure of one 63 MVAR reactor at 400 kV S/S Byrnihat of Me.ECL would be sent to CEA for investigation as directed above as suggested by SE(O) to CEA within one week.

During 33rd PCC meeting, Meghalaya representative requested NERPC to take up the matter with Director (Trans) regarding failure of above equipment at Byrnihat.

The Sub-committee requested NERPC to write to Director (Transmission), Me. PTCL regarding above failure of important reactor at Byrnihat.

NERPC has written to Director (T), Me. PTCL and the reply is awaited.

Meghalaya may kindly intimate the status.

A.7 Status of R&M Implementation of NER from PSDF:

The Sub-committee requested all the constituents to intimate the status of progress to NERPC regularly so that the same could be intimated to CERC.

Latest available status is enclosed at **Annexure - A.7.**

Constituents may kindly intimate the status.

A.8 Furnishing Protection Details of Transmission Lines, Transformers, Reactors and Bus Bars:

a. Transmission Line

As per section 43.4.c (Schedule V) of Technical Standards for construction of Electrical Plants and Electric Lines Regulation, 2010, Protection system of **400 kV lines** consists of Main I, Main II, DEF, Two Stage Over Voltage, Auto Reclosing and Carrier Aided Inter Tripping. Protection system of **220 kV lines** consists of Main I, Main II/Over Current & DEF, Auto Reclosing and Carrier Aided Inter Tripping. Protection system of **132 kV lines** consists of Main I, Over Current & DEF, Auto Reclosing and Carrier Aided Inter Tripping.

AEGCL, MSPCL, MePTCL, P&E, Mizoram, POWERGRID, NEEPCO (only AGBPP, Ranganadi HEP, Doyang HEP & AGTPP), NHPC & TSECL has furnished the information.

DoP, Arunachal Pradesh, DoP, Nagaland, NEEPCO (for Khandong, Kopili & Kopili Stg II), OTPC (for 132 kV lines) are requested to furnish Protection Details of Transmission Lines as per enclosed format in Annexure - A.8 (I&II).

b. Transformer

As per section 43.4.c (Schedule V) of Technical Standards for construction of Electrical Plants and Electric Lines Regulation, 2010, Protection system of **Transformer** consists of Differential Protection, Over Flux Protection, REF Protection, Backup Directional Over Current and Earth Fault Protection (HV

& LV side)/Impedance Protection, Buchholz, WTI, OTI, MOG, OSR for OLTC, PRD, SA, Tertiary Winding Protection, Over Load Alarm.

AEGCL, MSPCL, MePTCL, P&E, Mizoram, POWERGRID, NEEPCO (only AGBPP, Ranganadi HEP & AGTPP), NHPC, OTPC & TSECL has furnished the information.

DoP, Arunachal Pradesh, DoP, Nagaland, NEEPCO (for Khandong, Kopili & Kopili Stg II) are requested to furnish **Protection Details of Transformer** as per format in **Annexure-A.8 (I&II)**.

c. Reactor

As per section 43.4.c (Schedule V) of Technical Standards for construction of Electrical Plants and Electric Lines Regulation, 2010, Protection system of **Reactor** consists of Differential Protection, REF Protection, Backup Definite Time Over Current and Earth Fault Protection/Impedance Protection, Buchholz, WTI, OTI, MOG, SA.

AEGCL, MePTCL, NEEPCO (Rangaandi HEP), OTPC and POWERGRID have furnished the information.

d. Bus Bar & LBB

As per section 43.4.c (Schedule V) of Technical Standards for construction of Electrical Plants and Electric Lines Regulation, 2010, Bus Bar Protection and Local Breaker Backup Protection are to be provided in **220 kV and above voltage** interconnecting sub-station and all generating station switchyards.

MePTCL, POWERGRID, NEEPCO (AGTPP, AGBPP & Ranganadi HEP), NHPC & OTPC have furnished the information.

DoP, Arunachal Pradesh (Deomali), AEGCL (BTPS, Agia, Boko, Sarusajai, Langpi, Samaguri, Jawaharnagar, Mariani, Tinsukia) & NEEPCO (Kopili) are requested to furnish **Bus Bar Protection and Local Breaker Backup Protection** as per enclosed format in **Annexure-A.8 (I&II)**.

e. Bus Coupler

MSPCL, MePTCL, P&E, Mizoram, NEEPCO (only AGBPP, Ranganadi HEP & AGTPP) & NHPC have furnished the information.

DoP, Arunachal Pradesh, AEGCL, DoP, Nagaland, POWERGRID, NEEPCO (for Doyang, Khandong, Kopili & Kopili Stg II) & OTPC are requested to furnish **Bus Coupler Protection** as per enclosed format in **Annexure -A.8**.

Protection System Database prepared based on information furnished by power utilities of NER, which is attached at Annexure- A.8 (I&II). Power utilities of NER are requested to check & validate the same.

After detailed deliberation in 32nd PCC meeting, the Sub-committee requested all the constituents to furnish the above information to NERLDC latest by 10.05.2015.

Protection System Database prepared based on information furnished by power utilities of NER, which is attached at **Annexure - A.8**. Power utilities of NER were requested to check & validate the same.

During 33rd PCC meeting, the sub-committee requested NERPC to write a letter to remaining constituents (i.e. AEGCL (for Bus Coupler (for all) & Bus Bar & LBB (for BTPS, Agia, Boko, Sarusajai, Langpi, Samaguri, Jawaharnagar, Mariani, Tinsukia)), DoP, Arunachal Pradesh (for Transmission Line, Transformer, Bus Coupler, Bus Bar (for Deomali) & LBB (for Deomali), DOP, Nagaland (for Transmission Line, Transformer, Bus Coupler), NEEPCO (Transmission line (for Khandong & Kopili Stg-II), Transformer (for Kopili, Khandong & Kopili Stg-II), Bus Bar & LBB (Kopili), Bus Coupler (Kopili, Khandong, Kopili St II), OTPC (for Transmission Line, Transformer, Reactor, Bus Copuler, Bus Bar & LBB), POWEERGRID (for Bus Coupler) to furnish the data as per enclosed format in **Annexure - A.8** at the earliest.

NERPC has written letter to constituents above and the reply is awaited.

Concerned constituents may kindly intimate the current status.

A.9 Major Oscillations in NER:

NERLDC informed that during the month of May, 2015, there were persistent Low Frequency Oscillations (LFOs) in NER Grid which led to tripping of some generators in the Southern part of NER Grid around Khliehriat (Meghalaya) system.


The oscillations occurred from 03:38:56.080 Hrs to 03:41:37.040 Hrs (around 3 minutes) and from around 03:42:33.440 Hrs to around 03:45:24.480 Hrs (around 3 minutes) on 29.05.15, & from around 22:56:30 Hrs to 22:58:15 Hrs on 31st May 2015.

In both the incidents, Low Frequency Modes in the system around 1.2 Hz and it's 2nd Harmonic mode around 2.4 Hz was observed in the system, and the modes have Poor / Negative damping.

In the 29th May incident, the oscillations started after fault in Meghalaya system leading to tripping of 132 kV Khliehriat – Lumshnong line followed by oscillations in Leshka HEP of MePGCL and Khandong HEP of NEEPCO. There was tripping of Leshka units and Khandong units due to jerk in the system. The oscillations later continued between units of Kopili HEP and Kopili St-II HEP.

In the 31st May incident, the oscillations started again after fault in Meghalaya system leading to tripping of 132 kV Khliehriat (PG) – Khliehriat (MePTCL) I & II lines followed by oscillations in Leshka HPP of MePGCL and Khandong HEP of NEEPCO. There was tripping of Leshka units, Umiam St IV units and Khandong unit due to jerk in the system. The oscillations later continued between units of Kopili HEP and Kopili St-II HEP.

The Zone of oscillations in NER Grid is indicated below:

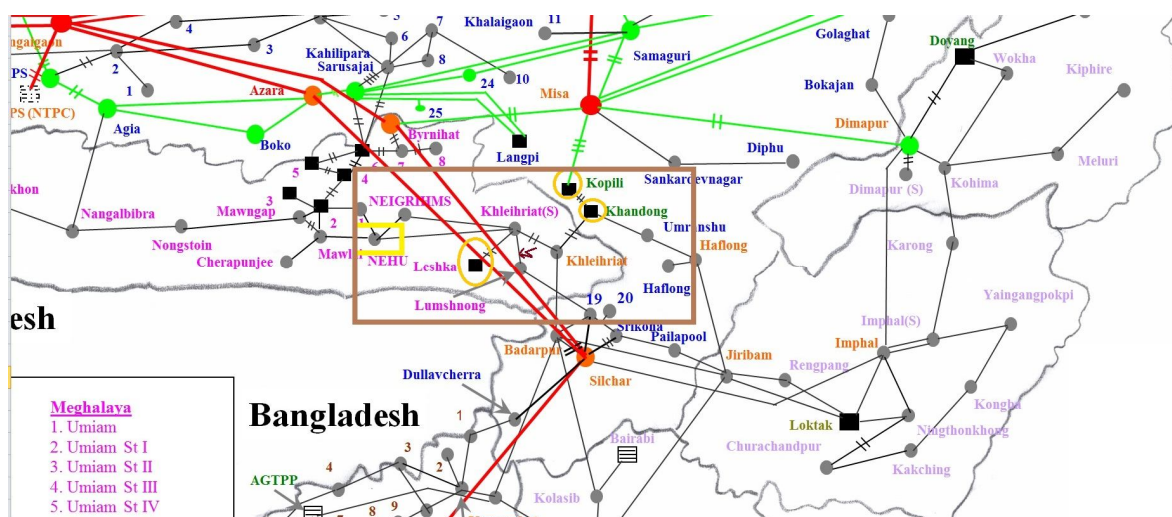

Oscillations were more prominent in Active power/ Frequency than in Voltage. It thus suggests a lack of system stability as a whole. To address this issue, PSS (Power System Stabilizers) may be installed in Myndtu Leshka Power Station to enhance stability of the system.

Members may like to discuss.

A.9 Grid Incidences during May, 2015:

The following numbers of Grid Disturbances (GD) occurred during the period w.e.f 1st May, 2015 to 31st May, 2015 :-

SI No	Control Area	Grid Disturbance in nos.	
		1 st May, 2015 to 31 st May, 2015	1 st January, 2015 to 31 st May, 2015
1	Palatana	1	5
2	AGBPP	0	1
3	AGTPP	1	4
4	Ranganadi	2	3
5	Kopili	0	1
6	Khandong	0	1
7	Doyang	0	2
8	Loktak	0	4
9	Arunachal Pradesh	2	22
10	Assam	4	25
11	Manipur	6	34
12	Meghalaya	6	9
13	Mizoram	2	5
14	Nagaland	1	13
15	Tripura	1	3

SI No	Category of GD	Grid Disturbance in nos.	
		1 st May, 2015 to 31 st May, 2015	1 st January, 2015 to 31 st May, 2015
1	GD 1	18	83
2	GD 2	2	4
3	GD 3	0	0
4	GD 4	0	0
5	GD 5	0	1
	Total	20	88

This is for information to the members. Remedial actions are to taken by the concerned power utilities of NER

A.10 Root cause analysis of Grid Disturbances:

i. Disturbance in Meghalaya system - Repeated tripping of 132 kV Khliehriat (PG) - Khliehriat (Me. PTCL) - I & II lines:

During the month of May, 2015, there were 6 nos. of grid disturbances in Khliehriat (including Lumshnong) area of Meghalaya.

W.e.f 01.06.15 to 08.06.15, there were 10 nos. events involving tripping of 132 kV Khliehriat (PG) - Khliehriat (MePTCL) I & II lines, resulting in 9 nos. of grid disturbances.

During the month of May15

- a. **At 1544 Hrs on 19.05.15**, 132 kV Khliehriat (PG) - Khliehriat (MePTCL) I & II lines (Line 1 : **Khliehriat (PG) - DP, Z-III, R-B-E & Khliehriat (MePTCL)- Not furnished** and Line 2: **Khliehriat (PG) - DP, Z-II, R-B-E & Khliehriat (MePTCL)- Not furnished**), 132 kV Khliehriat - Lumshnong line (**Khliehriat (MePTCL) - Earth Fault & Lumshnong - Not furnished**) and 132 kV Khliehriat - NEIGRIHMS line (**Khliehriat (MePTCL) - DP, Z1, R-Y-B & NEIGRIHMS - Not furnished**) tripped. Due to tripping of these elements, there was loss of load in Khliehriat area (including Lumshnong) of Meghalaya System and loss of generation from Myndtu Leshka HPP. System was restored progressively by 15:48 Hrs.

Load loss: 70 MW in Meghalaya

Generation Loss: 35 MW in Meghalaya (Leshka)

- b. **At 1043 Hrs on 23.05.15**, 132 kV Khliehriat (PG) - Khliehriat (MePTCL) I & II lines tripped (Line 1 : **Khliehriat (PG) - DP, Z-III, R-E & Khliehriat (MePTCL)- Not furnished** & Line II : **Khliehriat (PG) - DP, Z-II, R-E & Khliehriat (MePTCL)- Not furnished**), 132 kV Khliehriat (PG) - Khandong I line (**Khliehriat (PG) - No tripping & Khandong (NEEPCO) - Earth Fault**)

line tripped. Due to tripping of these elements, there was loss of load in Khliehriat (including Lumshnong) area of Meghalaya.

Load loss: 57 MW in Meghalaya

- c. **At 1425 Hrs on 23.05.15**, 132 kV Khliehriat (PG) - Khliehriat (MePTCL) I & II lines tripped (Line 1: **Khliehriat (PG) - DP, Z-III, B-E & Khliehriat (MePTCL) - Not furnished**) & Line 2: **Khliehriat (PG) - DP, Z-II, Y-E & Khliehriat (MePTCL) - Not furnished**). Due to tripping of these elements, there was loss of load in Khliehriat (including Lumshnong) area of Meghalaya.

Load loss: 15 MW in Meghalaya

- d. **At 0336 Hrs on 29.05.15**, 132 kV Khliehriat (MePTCL) – Lumshong line (**Khliehriat(MePTCL) - DP,Z-III,R-Y-B & Lumshong - Hand tripped**) line tripped. This resulted tripping of Unit 3 of Myndtu Leshka HPP of Meghalaya and Units 1 and 2 of Khandong due to heavy jerk. There were Low Frequency Oscillations (LFOs) of 1.2 Hz and 2.4 Hz modes in the system having poor or negative damping. Oscillations were observed in Leshka, Khandong, Kopili and Kopili St-II units.

Load loss: 24 MW in Meghalaya

Generation Loss: 84 MW [44 MW in Leshka and 40 MW Khandong]

- e. **At 0757 Hrs on 29.05.15**, 132 kV Khliehriat (PG) - Khliehriat (MePTCL) I & II lines (Line 1: **Khliehriat (PG) - DP, Z-III, R-Y-B & Khliehriat (MePTCL)- Not furnished** & Line 2 : **Khliehriat (PG) - DP, Z-II, R-Y-B & Khliehriat (MePTCL)- Not furnished**) tripped. Due to tripping of these elements, there was loss of load in Khliehriat (including Lumshnong) area of Meghalaya and loss of entire generation of Leshka HPP on Under-voltage.

Load loss: 73 MW in Meghalaya

Generation Loss: 105 MW in Meghalaya (Leshka)

- f. **At 2255 Hrs on 31.05.15**, 132 kV Khliehriat (PG) - Khliehriat (MePTCL) I & II lines (Line 1: **Khliehriat (PG) - DP, Z-III, R-B-E & Khliehriat (MePTCL)- Not furnished** & Line 2 : **Khliehriat (PG) - DP, Z-II, R-B-E & Khliehriat (MePTCL)- Not furnished**) tripped. Due to tripping of these elements, there was loss of load in Khliehriat (including Lumshnong) area of Meghalaya, loss of entire generation of Leshka HPP on Undervoltage and loss of entire generation of Umiam StIV. There was Low Frequency Oscillations (LFOs) of poor/negative damped modes around 1.2 Hz and 2.4 Hz only. Oscillations were observed in Leshka, Khandong, Kopili and Kopili St-II units.

Load loss: 73 MW in Meghalaya

Generation Loss: 105 MW in Meghalaya (Leshka and Umiam St- IV)

Category as per CEA Standards: GD-I

W.e.f. 01.06.15 to 08.06.15

- i. **At 1857 Hrs on 01.06.15**, 132 kV Khliehriat (PG) - Khliehriat (MePTCL) I & II lines tripped (Line I: **Khliehriat (PG) - DP, Z-II, R-Y-E & Khliehriat (MePTCL) - Not furnished** and Line II: **Khliehriat (PG) - DP, Z-III, R-Y-E & Khliehriat (MePTCL)- Not furnished**). Due to tripping of these elements, there was loss of load in Khliehriat (including Lumshnong) area of Meghalaya and generation loss in Leshka HEP.

Load loss: 88 MW in Meghalaya

Generation Loss: 122 MW in Meghalaya (Leshka)

- ii. **At 2356 Hrs on 01.06.15**, 132 kV Khliehriat (PG) - Khliehriat (MePTCL) I & II lines tripped (Line 1: **Khliehriat (PG) - Not furnished & Khliehriat (MePTCL) - Not furnished** and Line 2: **Khliehriat (PG) - Not furnished & Khliehriat (MePTCL) - Not furnished**). Due to tripping of these elements, there was loss of load in Khliehriat (including Lumshnong) area of Meghalaya and generation loss in Leshka HEP.

Load loss: 49 MW in Meghalaya

Generation Loss: 122 MW in Meghalaya (Leshka)

- iii. **At 2248 Hrs on 05.06.15**, 132 kV Khliehriat (PG) - Khliehriat (MePTCL) I & II lines tripped (Line 1: **Khliehriat (PG) - DP, Z-III, R-Y-B & Khliehriat (MePTCL) - Not furnished** and Line 2: **Khliehriat (PG) - DP, Z-III, R-Y-B & Khliehriat (MePTCL) - Not furnished**). Due to tripping of these elements, there was loss of load in Khliehriat (including Lumshnong) area of Meghalaya and generation loss in Leshka HEP.

Load loss: 67 MW in Meghalaya

Generation Loss: 114 MW in Meghalaya (Leshka)

- iv. **At 1816 Hrs on 06.06.15**, 132 kV Khliehriat (PG) - Khliehriat (MePTCL) I & II lines tripped (Line 1 : **Khliehriat (PG) - DP, Z-III, R-Y-B & Khliehriat (MePTCL) - Not furnished** and Line 2 : **Khliehriat (PG) - DP, Z-III, R-Y-B & Khliehriat (MePTCL)- Not furnished**). Due to tripping of these elements, there was loss of load in Khliehriat (including Lumshnong) area of Meghalaya and generation loss in Leshka HEP.

Load loss: 111 MW in Meghalaya

Generation Loss: 67 MW in Meghalaya (Leshka)

- v. **At 0056 Hrs on 08.06.15**, 132 kV Khliehriat (PG) - Khliehriat (MePTCL) I & II lines tripped (Line 1: **Khliehriat (PG) - DP, Z-III, R-Y-B & Khliehriat (MePTCL)- Not furnished** and Line 2: **Khliehriat (PG) - DP, Z-III, R-Y-B & Khliehriat (MePTCL)- Not furnished**) tripped. Due to tripping of these elements, there was loss of load in Khliehriat (including Lumshnong) area of Meghalaya and generation loss in Leshka HEP. 132 kV Khandong – Khliehriat (PG) I also tripped (**Khandong – Not furnished & Khliehriat(PG) – Not furnished**).

Load loss: 39 MW in Meghalaya

Generation Loss: 121 MW in Meghalaya (Leshka)

- vi. **At 2222 Hrs on 08.06.15**, 132 kV Khliehriat (PG) - Khliehriat (MePTCL) I & II lines tripped (Line 1: **Khliehriat (PG) - DP, Z-III, R-Y-B & Khliehriat (MePTCL)- Not furnished** and Line 2: **Khliehriat (PG) - DP, Z-II, R-Y-B & Khliehriat (MePTCL)- Not furnished**). Due to tripping of these elements, there was loss of load in Khliehriat (including Lumshnong) area of Meghalaya and generation loss in Leshka HEP.

Load loss: 58 MW in Meghalaya

Generation Loss: 121 MW in Meghalaya (Leshka)

- vii. **At 2317 Hrs on 08.06.15**, 132 kV Khliehriat (PG) - Khliehriat (MePTCL) I & II lines tripped (Line 1: **Khliehriat (PG) - DP, Z-III, R-Y-B & Khliehriat (MePTCL)- Not furnished** and Line 2: **Khliehriat (PG) - DP, Z-III, R-Y-B & Khliehriat (MePTCL)- Not furnished**) tripped. Due to tripping of these elements, there was loss of load in Khliehriat (including Lumshnong) area of Meghalaya and generation loss in Leshka HEP. 132 kV Khandong – Khliehriat (PG) I also tripped (**Khandong – Not furnished & Khliehriat(PG) – Over-current**).

Load loss: 112 MW in Meghalaya

Generation Loss: 67 MW in Meghalaya (Leshka)

- viii. **At 0318 Hrs on 09.06.15**, 132 kV Khliehriat (PG) - Khliehriat (MePTCL) I & II lines tripped (Line 1: **Khliehriat (PG) - DP, Z-III, R-Y-B & Khliehriat (MePTCL)- Not furnished** and Line 2: **Khliehriat (PG) - DP, Z-II, R-Y-B & Khliehriat (MePTCL)- Not furnished**) tripped. Due to tripping of these elements, there was loss of load in Khliehriat (including Lumshnong) area of Meghalaya and generation loss in Leshka HEP. 132 kV Khandong – Khliehriat (PG) I also tripped (**Khandong – Not furnished & Khliehriat(PG) – Earth Fault**).

Load loss: 77 MW in Meghalaya

Generation Loss: 44 MW in Meghalaya (Leshka)

- ix. **At 0508 Hrs on 09.06.15**, 132 kV Khliehriat (PG) - Khliehriat (MePTCL) I & II lines tripped (Line 1: **Khliehriat (PG) - DP, Z-III, Y-B-E & Khliehriat (MePTCL)- Not furnished** and Line 2: **Khliehriat (PG) - DP, Z-II, Y-B-E & Khliehriat (MePTCL)- Not furnished**) tripped. Due to tripping of these elements, there was loss of load in Khliehriat (including Lumshnong) area of Meghalaya and generation loss in Leshka HEP. 132 kV Khandong – Khliehriat (PG) I also tripped (**Khandong – Not furnished & Khliehriat(PG) – Earth Fault**).

Load loss: 75 MW in Meghalaya

Generation Loss: 38 MW in Meghalaya (Leshka)

Category as per CEA Standards: GD-I (for events from SI. No. a. to ix)

- x. **At 0056 Hrs on 08.06.15**, 132 kV Khandong – Khliehriat (PG) I tripped (**Khandong – Not furnished & Khliehriat(PG) – Not furnished**).

Analysis of events:

Due to tripping of these elements, power supply to Khliehriat (including Lumshnong) area of Meghalaya was interrupted repeatedly. It is suspected that there may be un-cleared fault in Meghalaya system or delayed fault clearance. As a result, several transmission lines tripped. In most of the cases, Leshka machines tripped and in some of the case, machines of Umiam St IV & Khandong tripped.

The un-cleared faults may create oscillations in the system. It was observed that there was oscillation of machines of Leshka along with machines of Khandong. As a result, machines of Leshka and machines of Khandong tripped. Even after tripping of these machines, the oscillations in the system was continued and observed between machines of Kopili and machines of Kopili Stg-II until the mode damping improves. Oscillations were more prominent in Active power/Frequency rather than in Voltage. It thus suggests a lack of system stability as a whole. To address this issue, PSS (Power System Stabilizers) may be installed in Leshka Power Station to enhance stability of the system.

DR output at both ends of all lines tripped required for proper analysis of the events.

Me. PTCL, Me. PGCL, NEEPCO & NERTS, POWERGRID may elaborate.

ii. Disturbance in AGTPP, Palatana and Tripura power system

- a. **At 1526 Hrs on 29.05.15**, due to tripping of 132 kV Agartala – Dhalabil line, 132 kV Baramura – Jirania line, 132 kV AGTPP - Agartala I line (**AGTPP - DP, Z-III, R-E & Agartala - No tripping**) & 132 kV AGTPP - Agartala II line (**AGTPP- DP, Z-III, R-E & Agartala - No tripping**), power supply to Tripura system was interrupted and all running units of AGTPP tripped (**No information from AGTPP regarding unit tripping**). 132 kV Palatana - Surajmani Nagar line & 132 kV Palatana – Udaipur line also tripped, Due to tripping of 132 kV Palatana - Surajmani Nagar line & 132 kV Palatana – Udaipur line, Palatana Module II tripped (**Due to tripping of Gas Booster Compressor**). Tripping of Palatana machines triggered SPS I at Silchar with load relief of 70 MW at South Assam.

Generation loss: 469 MW [Palatana = 335 MW, AGTPP = 76 MW]

Load Loss: 70 MW in Tripura

Category as per CEA Standards: GD-II

Analysis of events:

Due to tripping of all outgoing feeders of AGTPP, all the running units of AGTPP tripped. Due to tripping of 132 kV Palatana – Udaipur line and 132 kV Palatana – Surjamaninagar line, auxiliary system of Palatana Module II failed and subsequently Gas Booster Compressor (GBC) of Palatana Module II tripped.

In this event on 29-May-2015, the 400/132 kV, 125 MVA ICT at Palatana was out of service. Since supply to Auxiliaries of Palatana units are taken from 132 kV Grid of Tripura, outage of 132 kV Palatana – Udaipur S/C and 132 kV Palatana – Surjamaninagar S/C led to failure of supply to Auxiliary system of Palatana units and hence tripping of Palatana units. If another 400/132 kV ICT at Palatana were in place, this type of incident could have been averted. This transformer would also ensure enhanced reliability of supply and also satisfied the N-1 contingency criteria as specified in CEA's Manual on Transmission Planning Criteria, Jan'13.

As an alternative arrangement, in such cases, if UATs at Palatana are of sufficient capacity, the Auxiliary supply failure would not have occurred. OTPC, Palatana may explore the provision of enhancement of UAT to sufficient capacity.

DR output at both ends required for proper analysis of the events.

NEEPCO, TSECL, OTPC & NERTS, POWERGRID may elaborate.

iii. Disturbance in Manipur system

- a. At **1658 Hrs on 01.05.15**, due to tripping of 132 kV Imphal(PG) - Imphal I & II lines (Line I: **Imphal (PG) - Earth fault & Imphal (MSPCL) - Not furnished & Line II : Imphal (PG) - Earth fault & Imphal (MSPCL) -Not furnished**), power supply to Imphal (Capital) area of Manipur interrupted.

Load loss: 63 MW in Manipur.

- b. At **0906 Hrs on 12.05.15**, due to tripping of 132 kV Loktak- Ningthoukhong line (**Loktak - Earth Fault & Ningthoukhong - Not furnished**) & 132 kV Ningthoukhong - Imphal (PG) line (**Ningthoukhong - Not furnished & Imphal (PG) - Earth Fault**), power supply to Ningthoukhong area of Manipur interrupted.

Load loss: 28 MW in Manipur.

- c. At **1124 Hrs on 19.05.15**, due to tripping of 132 kV Imphal (PG) - Imphal (MSPCL) I & II lines (Line I: **Imphal (PG) - Earth fault & Imphal (MSPCL) - Not furnished** and Line II **Imphal (PG) - Earth fault & Imphal (MSPCL) - Not furnished**), power supply to Imphal (Capital) area of Manipur interrupted.

Load loss: 76 MW in Manipur.

- d. At **0137 Hrs on 21.05.15**, due to tripping of 132 kV Imphal (PG) - Imphal (MSPCL) I & II lines (Line I : **Imphal (PG) - Earth fault & Imphal (MSPCL) - Not furnished**) & Line II: **Imphal (PG)- Earth fault & Imphal (MSPCL)-Not furnished**), power supply to Imphal (Capital) area of Manipur interrupted.

Load loss: 30 MW in Manipur.

- e. At **1414 Hrs on 23.05.15**, due to tripping of 132 kV Imphal (PG) - Imphal (MSPCL) I & II lines (Line1: **Imphal (PG) - Earth fault & Imphal (MSPCL) - Not furnished**) & Line II: **Imphal (PG) - Earth fault & Imphal (MSPCL) - Not furnished**), power supply to Imphal (Capital) area of Manipur interrupted.

Load loss: 40 MW in Manipur.

- f. At **1714 Hrs on 23.05.15**, due to tripping of 132 kV Imphal (PG) - Imphal (MSPCL) I & II lines (Line 1: **Imphal (PG) - Earth fault & Imphal (MSPCL) - Not furnished** & Line 2: **Imphal (PG) - Earth fault & Imphal (MSPCL) - Not furnished**), power supply to Imphal (Capital) area of Manipur interrupted.

Load loss: 44 MW in Manipur.

Category as per CEA Standards: GD-I

Analysis of events:

It is suspected that there may be fault in MSPCL system in these cases. DR output at both ends of all lines tripped required for proper analysis of the events.

NHPC, MSPCL, & NERTS, POWERGRID may elaborate.

iv. Disturbance in Arunachal Pradesh and Gohpur area of Assam

- a. At **1138 Hrs on 18.05.15**, due to tripping of 400 kV Balipara - Ranganadi I (**Balipara (PG) – DP, Z-II, Y-B-E & Ranganadi (NEEPCO) – DP, Z-I, Y-B-E**), power supply to Ziro & Capital area of Arunachal Pradesh and Gohpur area of Assam interrupted. There was also generation loss in Ranganadi HEP. Power was extended to these areas through 400 kV Balipara- Ranganadi II at 1210 Hrs on 18.05.15. **400 kV Balipara- Ranganadi II was kept open w.e.f 0006 Hrs on 18.05.15 due to control bus voltage at Ranganadi.**

Load loss: 60 MW in Arunachal Pradesh & Assam
Generation Loss: 110 MW at Ranganadi (NEEPCO)

Category as per CEA Standards: GD-II

- b. At **0008 Hrs on 25.05.15**, due to tripping of 400 kV Balipara- Ranganadi I & II lines (Line 1: **Balipara(PG) – Overvoltage & Ranganadi (NEEPCO) – Overvoltage** & Line 2 : **Balipara (PG) – Overvoltage & Ranganadi (NEEPCO) – Overvoltage**) lines, power supply to Ziro & Capital area of Arunachal Pradesh and Gohpur area of Assam interrupted.

Load loss: 60 MW in Arunachal Pradesh & Assam

Category as per CEA Standards: GD-I

Analysis of Events:

DR outputs have been received from Ranganadi of above events. DR output from Balipara (PG) has been received for the tripping of 400 kV Balipara – Ranganadi I on 18th May 2015. DR output from Balipara (PG) in respect of tripping of lines on 25-May-2015 was not received.

Information from DR pertaining to 18th May 2015 tripping:

From the DR of Main-I at Balipara pertaining to 18th May 2015 case, a maximum L-L voltage of 407 kV (RMS) can be observed while the extremism was at 575 kV.

From the DR of Main-II at Balipara pertaining to 18th May 2015 incident, a maximum L-L voltage at around 407 kV (RMS) for duration of 287 milli-seconds could be observed and the maximum instantaneous extremism was 575 kV.

From the DR of Main-I at Ranganadi pertaining to the 18th May 2015 incident, a maximum L-L voltage of around 417 kV (RMS) for duration of 888 milli-seconds could be observed and the maximum instantaneous extremism was 592 kV. Also, from the DR, Main-2 operated signal is high (Main-II DR was, however, not furnished to NERLDC).

Information from DR pertaining to 25th May 2015 tripping:

From the DR of Main-I at Ranganadi pertaining to the 25th May 2015 incident, a maximum L-L voltage of around 445 kV (RMS) for a prolonged duration could be observed and the maximum instantaneous extremism was 630 kV. However, from the DR there is no operation of Circuit Breaker / Line opening that could be observed.

DR files before or after the incident would be required, and from both ends of the line for proper analysis. It is not clear when CB opening took place.

Any other item:

Date and Venue of next PCC

It is proposed to hold the 35th PCC meeting of NERPC on second week of July, 2015. The exact venue will be intimated in due course.

Format for intimating the failure of Transmission line Towers

1. Name of Transmission line with voltage level:
2. Length of line (km):
3. Type of configuration:
[(S/C, D/C, S/C strung on D/C towers,
narrow base etc.)]
4. Number of Towers and Type of Towers failed:
[suspension/ tension/ dead end/ special tower/
river crossing tower/ Powerline crossing/ Railway crossing etc.,
with/ without extension
(indicate the type & length of extension)]
5. Tower location no. with reference to nearest substation (indicate name):
6. Name and size of conductor:
7. No. of sub-conductors per bundle and bundle spacing:
8. Number and size of Ground wire/ OPGW (if provided):
9. Type of insulators in use (Porcelain/ Glass/ Polymer):
10. Configuration of insulators (I/ V/ Y/ tension):
11. No. of insulators per string and No. of strings per phase:
12. Year of construction/ commissioning:
13. Executing Agency:
14. Weather condition on the date of failure:
15. Terrain Category
16. Wind Zone (1/2/3/4/5/6) and velocity of wind:
17. Details of earthing of tower (pipe type/ Counter poise):
18. Line designed as per IS: 802 (1977/1995/ any other code):
19. The agency who designed the line:
20. Any special consideration in design:
21. Date and time of occurrence/ discovery of failure:
22. Power flow in the line prior to failure:
23. Any missing member found before/ after failure of towers:
24. Condition of foundation after failure:
25. Brief description of failure:
[alongwith photographs(if available), other
related information like tower schedule,
newspaper clipping for cyclone/ wind storm etc.]
26. Probable cause of failure:
27. Details of previous failure of the line/ tower:
28. Whether line will be restored on ERS or Space tower will be used:
29. Likely date of restoration:
30. Present Status:
31. Details of any Test carried out after failure:
32. Any other relevant information:

Profoma for details of equipment failure
(Information should be in detail and test reports should be furnished)

1. Name of Substation :
2. Utility/ Owner of substation :
3. Faulty Equipment :
4. Rating :
5. Make :
6. Sr. No. :
7. Year of manufacturing :
8. Year of commissioning :
9. Date and time of occurrence/ discovery of fault :
10. Fault discovered during :
(Operation/ maintenance)
11. Present condition of equipment :
12. Details of previous maintenance :
13. Details of previous failure :
14. Sequence of events/ Description of fault :
15. Details of Tests done after failure :
16. Conclusion/ recommendation :

Annexure – A.7

Rs. In Crore.

State	Name of Entity	Status	Funding Sought by Entity	Quantum of funding approved by Appraisal Committee (AC)	Quantum of funding approved by Monitoring Committee (MC)
Ar. Pradesh	DoP, AP	DPR submitted to CEA/NLDC- under examination of CEA – now it will be taken up in next meeting of the techno-economic sub-group	33.45	-	-
Assam	AEGCL	Scheme already approved by Monitoring Committee – MoP sanctioned awaited	382.48	299.37	299.37
Manipur	MSPCL	DPR to be submitted	-	-	-
Meghalaya	Me. PTCL	Scheme already approved by Appraisal Committee & approval by Monitoring Committee is awaited	102.8	69.19 and recommended to MC	-
	Me. PGCL	DPR submitted to CEA/NLDC- under examination of CEA – now it will be taken up in next meeting of the techno-economic sub-group	48.16	-	-
Mizoram	DoP, Mizoram	Revised DPR submitted to CEA/NLDC- under examination of CEA – now it will be taken up in next meeting of the techno-economic sub-group	31.38	-	-
Nagaland	DoP, Nagaland	Scheme already approved by Monitoring Committee – MoP sanctioned awaited	39.96	39.96	39.96
Tripura	TSECL	Revised DPR submitted to CEA/NLDC- under examination of CEA – now it will be taken up in next meeting of the techno-economic sub-group	-		

132 kV Transmission Line Protection Details

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details							Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) Over Current & Earth Fault Relay exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes / No)	Carrier aided Inter-tripping exists (Yes / No)	Power Swing Blocking Feature exists (Yes / No)	Pole Discrepancy Relay exists (Yes / No)	Number of Core used for CT & VT, used for Main I	Disturbance Recorder exists (Yes / No)	Event Logger / Sequential Event Recorder exists (Yes / No)	Fault Locator exists (Yes / No)
1. Owner of Line : POWERGRID													

Note : 1) Main-I Protection indicates Distance Protection
 2) Type of Relay indicates it's operational mechanism - Numerical / Static / Electro-mechanical
 3) List of inbuilt features of Numerical Relays are also to be furnished alongwith this format

220 kV Transmission Line Protection Details

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details										Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Main II Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) type Earth Fault Relay exists (Yes/No)	Two stage Over-Voltage Protection exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes/No)	Carrier aided Inter-tripping exists (Yes/No)	Power Swing Blocking Feature exists (Yes/No)	Pole Discrepancy Relay exists (Yes/No)	Number of Core used for CT & VT, used for Main I	Number of Core used for CT & VT, used for Main II	Disturbance Recorder exists (Yes/No)	Event Logger / Sequential Event Recorder exists (Yes/No)	Fault Locator exists (Yes/No)

1. Owner of Line :

- Note 1) Main-I Protection indicates Distance Protection
 2) Main-II Protection indicates one of Distance Protection / Directional Comparison Protection / Phase Segregated Line Differential protection
 3) Type of Relay indicates it's operational mechanism - Numerical / Static / Electro-mechanical
 4) List of inbuilt features of Numerical Relays are also to be furnished alongwith

400 kV Transmission Line Protection Details

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details										Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Main II Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) type Earth Fault Relay exists (Yes/No)	Two stage Over-Voltage Protection exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes/No)	Carrier aided Inter-tripping exists (Yes/No)	Power Swing Blocking Feature exists (Yes/No)	Pole Discrepancy Relay exists (Yes / No)	Number of Core used for CT & VT, used for Main I	Number of Core used for CT & VT, used for Main II	Disturbance Recorder exists (Yes/No)	Event Logger / Sequential Event Recorder exists (Yes/No)	Fault Locator exists (Yes/No)

1. Owner of Line : POWERGRID

- Note 1) Main-I Protection indicates Distance Protection
- 2) Main-II Protection indicates one of Distance Protection / Directional Comparison Protection / Phase Segregated Line Differential protection
- 3) Type of Relay indicates it's operational mechanism - Numerical / Static / Electro-mechanical
- 4) List of inbuilt features of Numerical Relays are also to be furnished alongwith

Transformer Protection Details

Sl. No.	Name of Transformer	LV side/ HV side	Differential Protection exists (Yes/No)	Over Fluxing Protection exists (Yes/No)	REF Protection exists (Yes/No)	Directional Over Current Protection exists (Yes/No)	Impedance Protection exists (Yes/No)	Buchholz Operation exists (Yes/No)	WTI Protection exists (Yes/No)	OTI Protection exists (Yes/No)	MOG with low oil level alarm exists (Yes/No)	OSR for OLTC exists (Yes/No)	PRD exists (Yes/No)	SA exists (Yes/No)	Tertiary Winding Protection exists (Yes/No)	Overload Alarm exists (Yes/No)
---------	---------------------	---------------------	---	---	--------------------------------	---	--------------------------------------	------------------------------------	--------------------------------	--------------------------------	--	------------------------------	---------------------	--------------------	---	--------------------------------

1. Owner of Transformer :

1		LV side														
		HV side														
2		LV side														
		HV side														
3		LV side														
		HV side														
4		LV side														
		HV side														
5		LV side														
		HV side														
6		LV side														
		HV side														
7		LV side														
		HV side														
8		LV side														
		HV side														
9		LV side														
		HV side														
10		LV side														
		HV side														
11		LV side														
		HV side														
12		LV side														
		HV side														
13		LV side														
		HV side														
14		LV side														
		HV side														
15		LV side														
		HV side														

Note : 1. REF : Restricted Earth Fault, 2. WTI : Winding Temperature Indicator., 3. OTI : Oil Temperature Indicator)
 4. MOG : Magnetic Oil Gauge, 5. OSR : Oil Surge Relay, 6. OLTC : On Load Tap Changer
 7. PRD : Pressure Relieve Device, 8. SA : Surge Arrestor
 9. List of inbuilt features of Numerical Relays are also to be furnished

Reactor Protection Details

Sl. No.	Name of Line Reactor/ Bus Reactor/ Tertiary Reactor	Differential Protection exists (Yes/No)	REF Protection exists (Yes/No)	Definite Time Over Current Protection exists (Yes/No)	Earth Fault Protection exists (Yes/No)	Buchholz Operation exists (Yes/No)	WTI Protection exists (Yes/No)	OTI Protection exists (Yes/No)	MOG with low oil level alarm exists (Yes/No)	SA exists (Yes/No)
----------------	--	--	---------------------------------------	--	---	---	---------------------------------------	---------------------------------------	---	---------------------------

1. Owner of Reactor :

Note : 1. REF : Restricted Earth Fault, 2. WTI : Winding Temperature Indicator., 3. OTI : Oil Temperature Indicator)
 4. MOG : Magnetic Oil Gauge, 5. SA : Surge Arrestor
 6. List of inbuilt features of Numerical Relays are also to be furnished alongwith this format

Annexure I

Bus Bar & Local Breaker Backup(LBB) Protection Details

Sl.No.	Name of Bus Bar	Bus Bar Protection exists (Yes/No)	LBB Protection exists (Yes/No)
--------	-----------------	------------------------------------	--------------------------------

1. Owner of Bus Bar/LBB

Note : 1. List of inbuilt features of Numerical Relays are also to be furnished alongwith this

Bus Coupler Protection Details

Sl.No.	Name of Bus Coupler	Non directional O/C Protection exists (Yes/No)	Non directional E/F Protection exists (Yes/No)
1. Owner of Bus Coupler			

Note : 1. List of inbuilt features of Numerical Relays are also to be furnished alongwith this

132 kV Transmission Line Protection Details

Annexure-A.8 (II)

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details							Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) Over Current & Earth Fault Relay exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes / No)	Carrier aided Inter-tripping exists (Yes / No)	Power Swing Blocking Feature exists (Yes / No)	Pole Discrepancy Relay exists (Yes / No)	Number of Core used for CT & VT, used for Main I	Disturbance Recorder exists (Yes / No)	Event Logger / Sequential Event Recorder exists (Yes / No)	Fault Locator exists (Yes / No)

I. Owner of Line/End: Assam, AEGCL

1	Balipara-Depota	132	Balipara	Yes (7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Depota	Yes (7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
2	Balipara-Ghoramari	132	Balipara	Yes (7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Ghoramari	Yes (7SA61 SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
3	Depota-Ghoramari	132	Depota	Yes (7SA52 SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Ghoramari	Yes (7SA61 SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
4	Balipara- Gohpur	132	Balipara	Yes (7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Gohpur	Yes (REL670 ABB)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
5	Barnagar-Dhaligaon	132	Barnagar	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Dhaligaon	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
6	Barnagar-Rangia	132	Barnagar	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Rangia	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
7	B.Chariali-Depota	132	B.Chariali	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Depota	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
8	B.Chariali-Gohpur	132	B.Chariali	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Gohpur	Yes(SEL321)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes

132 kV Transmission Line Protection Details

Annexure-A.8 (II)

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details							Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) Over Current & Earth Fault Relay exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes / No)	Carrier aided Inter-tripping exists (Yes / No)	Power Swing Blocking Feature exists (Yes / No)	Pole Discrepancy Relay exists (Yes / No)	Number of Core used for CT & VT, used for Main I	Disturbance Recorder exists (Yes / No)	Event Logger / Sequential Event Recorder exists (Yes / No)	Fault Locator exists (Yes / No)
18	Dhaligaon-Salakati II	132	Dhaligaon										
			Salakati II										
19	Dibrugarh-Moran	132	Dibrugarh										
			Moran										
20	Dibrugarh-Behiating	132	Dibrugarh	Yes (7SA52 SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Behiating	Yes (7SA61 SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
21	Moran-Behiating	132	Moran	Yes (GRZ-100 TOSHIBA)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Behiating	Yes (7SA61 SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
22	Dibrugarh-Tinsukia	132	Dibrugarh	Yes (7SA52 SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Tinsukia	Yes (7SA52 SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
23	Garmur-Bokakhat	132	Garmur	Yes (7SA61 SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Bokakhat	Yes (GRZ-100 TOSHIBA)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
24	Gohpur-North Lakhimpur I	132	Gohpur	Yes (7SA52 SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			North Lakhimpur I	Yes (D60 GE)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
25	Gohpur-North Lakhimpur II	132	Gohpur	Yes (D60 GE)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			North Lakhimpur II	Yes (D60 GE)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
26	Dimapur (PG) - Bokajan	132	Dimapur (PG)	PGCIL	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Bokajan	Yes (P442 MICOM)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes

132 kV Transmission Line Protection Details

Annexure-A.8 (II)

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details							Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) Over Current & Earth Fault Relay exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes / No)	Carrier aided Inter-tripping exists (Yes / No)	Power Swing Blocking Feature exists (Yes / No)	Pole Discrepancy Relay exists (Yes / No)	Number of Core used for CT & VT, used for Main I	Disturbance Recorder exists (Yes / No)	Event Logger / Sequential Event Recorder exists (Yes / No)	Fault Locator exists (Yes / No)
27	Golaghat-Mariani	132	Golaghat	Yes (GRZ-100 TOSHIBA)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Mariani	Yes (7SA52 SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
28	Golaghat-Bokajan	132	Golaghat	Yes (GRZ-100 TOSHIBA)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Bokajan	Yes (7SA52 SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
29	Gossaingaon-Gauripur	132	Gossaigaon	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Gauripur	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
30	Haflong - Lower Haflong	132	Haflong		Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Lower Haflong		Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
31	Kahilipara-Chandrapur	132	Kahilipara										
			Chandrapur										
32	CTPS - Jagiroad (Bagjhap)	132	CTPS	Yes(D60 GE)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Jagiroad (Bagjhap)	Yes (7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
33	Jagiroad (Bagjhap) - HPC, Jagiroad	132	Jagiroad (Bagjhap)	Yes (7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			HPC, Jagiroad	NoT KNOWN									
34	Nazira - Jorhat	132	Nazira	Yes (7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Jorhat	Yes(D60 GE)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
35	Kahilipara-Narengi	132	Kahilipara	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Narengi	Yes(REL670 ABB)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes

132 kV Transmission Line Protection Details

Annexure-A.8 (II)

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details							Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMTL) Over Current & Earth Fault Relay exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes / No)	Carrier aided Inter-tripping exists (Yes / No)	Power Swing Blocking Feature exists (Yes / No)	Pole Discrepancy Relay exists (Yes / No)	Number of Core used for CT & VT, used for Main I	Disturbance Recorder exists (Yes / No)	Event Logger / Sequential Event Recorder exists (Yes / No)	Fault Locator exists (Yes / No)
36	Kahilipara-Rangia	132	Kahilipara	Yes (7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Rangia	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
37	Kahilipara-Sarusajai I	132	Kahilipara	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Sarusajai I	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
38	Kahilipara-Sarusajai II	132	Kahilipara	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Sarusajai II	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
39	Kahilipara-Sarusajai III	132	Kahilipara	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Sarusajai III	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
40	Kahilipara-Sarusajai IV	132	Kahilipara	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Sarusajai IV	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
41	Kahilipara-Sisugram	132	Kahilipara	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Sisugram	Yes(RAZOA ABB)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
42	Dullavcherra - Dharmanagar	132	Dullavcherra	Yes (7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Dharmanagar	NoT KNOWN	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
43	Lakwa-Mariani	132	Lakwa	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Mariani	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes

132 kV Transmission Line Protection Details

Annexure-A.8 (II)

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details							Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) Over Current & Earth Fault Relay exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes / No)	Carrier aided Inter-tripping exists (Yes / No)	Power Swing Blocking Feature exists (Yes / No)	Pole Discrepancy Relay exists (Yes / No)	Number of Core used for CT & VT, used for Main I	Disturbance Recorder exists (Yes / No)	Event Logger / Sequential Event Recorder exists (Yes / No)	Fault Locator exists (Yes / No)
44	Lakwa-Moran	132	Lakwa	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Moran	Yes(GRZ-100 TOSHIBA)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
45	Srikona - Panchgram(Old)	132	Srikona	Yes(REL670 ABB)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Panchgram(Old)	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
46	Panchgram - Panchgram(Old)	132	Panchgram	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Panchgram(Old)	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
47	NTPS - LTPS (Maidela)	132	NTPS	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			LTPS (Maidela)	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
48	NTPS - Sonari	132	NTPS	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Sonari	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
49	Sonari- LTPS (Maidela)	132	Sonari	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			LTPS (Maidela)	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
50	Lakwa-Namrup I	132	Lakwa	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Namrup I	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
51	Lakwa-Namrup II	132	Lakwa	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Namrup II	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes

132 kV Transmission Line Protection Details

Annexure-A.8 (II)

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details							Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) Over Current & Earth Fault Relay exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes / No)	Carrier aided Inter-tripping exists (Yes / No)	Power Swing Blocking Feature exists (Yes / No)	Pole Discrepancy Relay exists (Yes / No)	Number of Core used for CT & VT, used for Main I	Disturbance Recorder exists (Yes / No)	Event Logger / Sequential Event Recorder exists (Yes / No)	Fault Locator exists (Yes / No)
52	Lakwa-Nazira	132	Lakwa	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Nazira	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
53	Mariani-Garmur I	132	Mariani	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Garmur I	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
54	Mariani-Garmur II	132	Mariani	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Garmur II	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
55	Nalbari-Rangia	132	Nalbari	Yes(REL670 ABB)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Rangia	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
56	Namrup-Tinsukia	132	Namrup	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Tinsukia	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
57	Nazira-Betbari	132	Nazira	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Betbari	Yes(GRZ-100 TOSHIBA)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
58	North Lakhimpur-Dhemaji	132	North Lakhimpur	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Dhemaji	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
59	North Lakhimpur- Majuli	132	North Lakhimpur	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Majuli	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes

132 kV Transmission Line Protection Details

Annexure-A.8 (II)

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details							Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) Over Current & Earth Fault Relay exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes / No)	Carrier aided Inter-tripping exists (Yes / No)	Power Swing Blocking Feature exists (Yes / No)	Pole Discrepancy Relay exists (Yes / No)	Number of Core used for CT & VT, used for Main I	Disturbance Recorder exists (Yes / No)	Event Logger / Sequential Event Recorder exists (Yes / No)	Fault Locator exists (Yes / No)
60	Narengi- Chandrapur	132	Narengi	Yes(REL670 ABB)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Chandrapur	Yes(D60 GE)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
61	Pailapool-Srikona	132	Pailapool	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Srikona	Yes(REL670 ABB)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
62	Panchgram-Dullavchera	132	Panchgram	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Dullavchera	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
63	Panchgram-HPL	132	Panchgram	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			HPL	NoT KNoWN									
64	Panchgram-Srikona	132	Panchgram	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Srikona	Yes(REL670 ABB)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
65	Rangia (Chirakhundi) - Nalbari (Sariahatali)	132	Rangia (Chirakhundi)	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Nalbari (Sariahatali)	Yes(REL670 ABB)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
66	Rangia-Rowta	132	Rangia	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Rowta	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes

132 kV Transmission Line Protection Details

Annexure-A.8 (II)

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details							Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) Over Current & Earth Fault Relay exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes / No)	Carrier aided Inter-tripping exists (Yes / No)	Power Swing Blocking Feature exists (Yes / No)	Pole Discrepancy Relay exists (Yes / No)	Number of Core used for CT & VT, used for Main I	Disturbance Recorder exists (Yes / No)	Event Logger / Sequential Event Recorder exists (Yes / No)	Fault Locator exists (Yes / No)
67	Rangia-Sipajhar	132	Rangia	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Sipajhar	Yes(REL670 ABB)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
68	Rangia-Sisugram	132	Rangia	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Sisugram	Yes(RAZOA ABB)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
69	Samaguri- B.Chariali	132	Samaguri	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			B.Chariali	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
70	Samaguri- Khalaigaon	132	Samaguri	Yes(P442 MICOM)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Khalaigaon	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
71	Samaguri-S.Dev Nagar I	132	Samaguri	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			S.Dev Nagar I	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
72	Diphu-S.DevNagar	132	Diphu	Yes(GRZ-100 TOSHIBA)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			S.Dev Nagar	Yes(P442 MICOM)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
73	Sipajhar-Rowta	132	Sipajhar	Yes(REL670 ABB)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Rowta	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
74	Tinsukia-Margherita I	132	Tinsukia	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Margherita I	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes

132 kV Transmission Line Protection Details

Annexure-A.8 (II)

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details							Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) Over Current & Earth Fault Relay exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes / No)	Carrier aided Inter-tripping exists (Yes / No)	Power Swing Blocking Feature exists (Yes / No)	Pole Discrepancy Relay exists (Yes / No)	Number of Core used for CT & VT, used for Main I	Disturbance Recorder exists (Yes / No)	Event Logger / Sequential Event Recorder exists (Yes / No)	Fault Locator exists (Yes / No)
75	Tinsukia-Margherita II	132	Tinsukia	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Margherita II	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
76	Nalkata-Gohpur I	132	Nalkata										
			Gohpur I										
77	Nalkata-Gohpur II	132	Nalkata										
			Gohpur II										
78	Dispur-KHP	132	Dispur	Yes(P442 MICOM)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			KHP	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
79	Dispur-Chandrapur	132	Dispur	Yes(P442 MICOM)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Chandrapur	Yes(D60 GE)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
80	Bokajan-Dimapur	132	Bokajan										
			Dimapur										
81	Chandrapur-Bagjap	132	Chandrapur										
			Bagjap										
82	LTPS (Maidela) - Nazira I	132	LTPS (Maidela)	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Nazira I	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
83	LTPS (Maidela) - Nazira II	132	LTPS (Maidela)	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Nazira II	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
84	Sankardev Nagar (Lanka) - Diphu	132	Sankardev Nagar (Lanka)	Yes(P442 MICOM)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Diphu	Yes(GRZ-100 TOSHIBA)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
85	Sankardev Nagar (Lanka) - TELCOM	132	Sankardev Nagar (Lanka)	Yes(P442 MICOM)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			TELCOM	Not KNown	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes

132 kV Transmission Line Protection Details

Annexure-A.8 (II)

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details							Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) Over Current & Earth Fault Relay exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes / No)	Carrier aided Inter-tripping exists (Yes / No)	Power Swing Blocking Feature exists (Yes / No)	Pole Discrepancy Relay exists (Yes / No)	Number of Core used for CT & VT, used for Main I	Disturbance Recorder exists (Yes / No)	Event Logger / Sequential Event Recorder exists (Yes / No)	Fault Locator exists (Yes / No)
2. Owner of Line/End: MSPCL (Manipur)													
1	Ningthoukhong - Churanchandpur I	132	Ningthoukhong	Yes	Yes	Yes	No	No	Yes	4 & 3	No	No	No
			Churanchandpur	Yes	Yes	Yes	No	No	Yes	4 & 3	No	No	No
2	Ningthoukhong - Churanchandpur II	132	Ningthoukhong	Yes	Yes	Yes	No	No	Yes	4 & 3	No	No	No
			Churanchandpur	Yes	Yes	Yes	No	No	Yes	4 & 3	No	No	No
3	Rengpang - Jiribam	132	Rengpang	Yes	Yes	Yes	No	No	Yes	4 & 3	No	No	No
			Jiribam(Manipur)	Yes	Yes	Yes	No	No	Yes	4 & 3	No	No	No
4	Imphal(Manipur) - Karong	132	Imphal(Manipur)	Yes	Yes	Yes	No	No	Yes	4 & 3	No	No	No
			Karong	Yes	Yes	Yes	No	No	Yes	4 & 3	No	No	No
5	Imphal(Manipur) - Yaingangpokpi	132	Imphal(Manipur)	Yes	Yes	Yes	No	No	Yes	4 & 3	No	No	No
			Yaingangpokpi	Yes	Yes	Yes	No	No	Yes	4 & 3	No	No	No
6	Yaingangpokpi - Kongba	132	Yaingangpokpi	Yes	Yes	Yes	No	No	Yes	4 & 3	No	No	No
			Kongba	Yes	Yes	Yes	No	No	Yes	4 & 3	No	No	No
7	Kongba - Kakching	132	Kongba	Yes	Yes	Yes	No	No	Yes	4 & 3	No	No	No
			Kakching	Yes	Yes	Yes	No	No	Yes	4 & 3	No	No	No
8	Kakching - Churanchandpur	132	Kakching	Yes	Yes	Yes	No	No	Yes	4 & 3	No	No	No
			Churanchandpur	Yes	Yes	Yes	No	No	Yes	4 & 3	No	No	No

132 kV Transmission Line Protection Details

Annexure-A.8 (II)

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details							Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) Over Current & Earth Fault Relay exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes / No)	Carrier aided Inter-tripping exists (Yes / No)	Power Swing Blocking Feature exists (Yes / No)	Pole Discrepancy Relay exists (Yes / No)	Number of Core used for CT & VT, used for Main I	Disturbance Recorder exists (Yes / No)	Event Logger / Sequential Event Recorder exists (Yes / No)	Fault Locator exists (Yes / No)

3. Owner of Line/End: Meghalaya, MePTCL

1	Umiam St IV (Nongkhylllem) - Umtru I	132	Umiam St IV (Nongkhylllem)	Yes, ABB make REL670, Numerical	Yes, Directional P127, Areva make	No	Yes, REL670 Relay	Yes, REL670 Relay	No	1	Yes, REL670 & P127 Relay	Yes, REL670 & P127 Relay	Yes, REL670 Relay
			Umtru	Yes, Areva make P442, Numerical	Yes, Directional CDD, EE make	No	Yes, P442 Relay	Yes, P442 Relay	No	1	Yes, P442 Relay	Yes, P442 Relay	Yes, P442 Relay
2	Umiam St IV (Nongkhylllem) - Umtru II	132	Umiam St IV (Nongkhylllem)	Yes, ABB make REL670, Numerical	Yes, Directional P127, Areva make	No	Yes, REL670 Relay	Yes, REL670 Relay	No	1	Yes, REL670 & P127 Relay	Yes, REL670 & P127 Relay	Yes, REL670 Relay
			Umtru	Yes, Toshiba make GRZ100, Numerical	Yes, Directional CDD, EE make	No	Yes, GRZ100 Relay	Yes, GRZ100 Relay	No	1	Yes, GRZ100 Relay	Yes, GRZ100 Relay	Yes, GRZ100 Relay
3	Umiam St III (Kyrdemkulai) - Umtru I	132	Umiam St III (Kyrdemkulai)	Yes, ABB make REL670, Numerical	Yes, Directional P127, Areva make	No	Yes, REL670 Relay	Yes, REL670 Relay	No	1	Yes, REL670 & P127 Relay	Yes, REL670 & P127 Relay	Yes, REL670 Relay
			Umtru	Yes, Areva make P442, Numerical	Yes, Directional JNP096, JVS make	No	Yes, P442 Relay	Yes, P442 Relay	No	1	Yes, P442 Relay	Yes, P442 Relay	Yes, P442 Relay
4	Umiam St III (Kyrdemkulai) - Umtru II	132	Umiam St III (Kyrdemkulai)	Yes, Toshiba make GRZ100, Numerical	Yes, Directional P127, Areva make	No	Yes, GRZ100 Relay	Yes, GRZ100 Relay	No	1	Yes, GRZ100 & P127 Relay	Yes, GRZ100 & P127 Relay	Yes, GRZ100 Relay
			Umtru	Yes, Areva make P442, Numerical	Yes, Directional JNP096, JVS make	No	Yes, P442 Relay	Yes, P442 Relay	No	1	Yes, P442 Relay	Yes, P442 Relay	Yes, P442 Relay
5	Umiam St III (Kyrdemkulai) - Umiam St I (Sumer) I	132	Umiam St III (Kyrdemkulai)	Yes, ABB make REL670, Numerical	Yes, Directional P127, Areva make	No	Yes, REL670 Relay	Yes, REL670 Relay	No	1	Yes, REL670 & P127 Relay	Yes, REL670 & P127 Relay	Yes, REL670 Relay
			Umiam St I (Sumer)	Yes, Areva make P442, Numerical	Yes, Directional P141, Areva make	No	Yes, P442 Relay	Yes, P442 Relay	No	1	Yes, P442 & P141Relay	Yes, P442 & P141Relay	Yes, P442 Relay

132 kV Transmission Line Protection Details

Annexure-A.8 (II)

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details							Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) Over Current & Earth Fault Relay exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes / No)	Carrier aided Inter-tripping exists (Yes / No)	Power Swing Blocking Feature exists (Yes / No)	Pole Discrepancy Relay exists (Yes / No)	Number of Core used for CT & VT, used for Main I	Disturbance Recorder exists (Yes / No)	Event Logger / Sequential Event Recorder exists (Yes / No)	Fault Locator exists (Yes / No)
6	Umiam St III (Kyrdemkulai) - Umiam St I (Sumer) II	132	Umiam St III (Kyrdemkulai)	Yes, ABB make REL670, Numerical	Yes, Directional P127, Areva make	No	Yes, REL670 Relay	Yes, REL670 Relay	No	1	Yes, REL670 & P127 Relay	Yes, REL670 & P127 Relay	Yes, REL670 Relay
			Umiam St I (Sumer)	Yes, Areva make P442, Numerical	Yes, Directional P141, Areva make	No	Yes, P442 Relay	Yes, P442 Relay	No	1	Yes, P442 & P141Relay	Yes, P442 & P141Relay	Yes, P442 Relay
7	EPIP II - Umtru I	132	EPIP II	No	No	No	No	No	No	0	No	No	No
			Umtru	No	Yes, Directional IDMTL, ER make	No	No	No	No	No	0	No	No
8	EPIP II - Umtru II	132	EPIP II	No	Yes, Directional CDD, ER make	No	No	No	No	0	No	No	No
			Umtru	No	Yes, Directional JNP060, JVS make	No	No	No	No	0	No	No	No
9	EPIP II - EPIP I (I)	132	EPIP II	No	No	No	No	No	No	0	No	No	No
			EPIP I	No	No	No	No	No	No	0	No	No	No
10	EPIP II - EPIP I (II)	132	EPIP II	No	No	No	No	No	No	0	No	No	No
			EPIP I	No	No	No	No	No	No	0	No	No	No
11	Khliehriat - Myntdu Leshka I	132	Khliehriat	Yes, ABB make REL670, Numerical	Yes, Directional REX521,ABB make	No	Yes, REL670 Relay	Yes, REL670 Relay	No	1	Yes, REL670 & REX521 Relay	Yes, REL670 & REX521 Relay	Yes, REL670 Relay
			Myntdu Leshka	Yes, ABB make REL670, Numerical	Yes, Directional REX521,ABB make	No	Yes, REL670 Relay	Yes, REL670 Relay	No	1	Yes, REL670 & REX521 Relay	Yes, REL670 & REX521 Relay	Yes, REL670 Relay
12	Khliehriat - Myntdu Leshka II	132	Khliehriat	Yes, ABB make REL670, Numerical	Yes, Directional REX521,ABB make	No	Yes	Yes	No	1	Yes, REL670 & REX521 Relay	Yes, REL670 & REX521 Relay	Yes
			Myntdu Leshka	Yes, ABB make REL670, Numerical	Yes, Directional REX521,ABB make	No	Yes, REL670 Relay	Yes, REL670 Relay	No	1	Yes, REL670 & REX521 Relay	Yes, REL670 & REX521 Relay	Yes, REL670 Relay

132 kV Transmission Line Protection Details

Annexure-A.8 (II)

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details							Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) Over Current & Earth Fault Relay exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes / No)	Carrier aided Inter-tripping exists (Yes / No)	Power Swing Blocking Feature exists (Yes / No)	Pole Discrepancy Relay exists (Yes / No)	Number of Core used for CT & VT, used for Main I	Disturbance Recorder exists (Yes / No)	Event Logger / Sequential Event Recorder exists (Yes / No)	Fault Locator exists (Yes / No)
13	Killing - EPIP II (I)	132	Killing	Yes, ABB make REL670, Numerical	Yes, Areva make P442, Numerical	No	Yes, REL670, P442 Relay	Yes, REL670, P442 Relay	No	1	Yes, REL670, P442 Relay	Yes, REL670, P442 Relay	Yes, REL670, P442 Relay
			EPIP II	Yes, Areva make P442, Numerical	Yes, Directional P127, Areva make	No	Yes, P442 Relay	Yes, P442 Relay	No	1	Yes, P442 & P127 Relay	Yes, P442 & P127 Relay	Yes, P442 Relay
14	Killing - EPIP II (II)	132	Killing	Yes, ABB make REL670, Numerical	Yes, Areva make P442, Numerical	No	Yes, REL670, P442 Relay	Yes, REL670, P442 Relay	No	1	Yes, REL670, P442 Relay	Yes, REL670, P442 Relay	Yes, REL670, P442 Relay
			EPIP II	Yes, Areva make P442, Numerical	Yes, Directional P127, Areva make	No	Yes, P442 Relay	Yes, P442 Relay	No	1	Yes, P442 & P127 Relay	Yes, P442 & P127 Relay	Yes, P442 Relay
15	Umiam St I (Sumer) - Mawngap I	132	Umiam St I (Sumer)										
			Mawngap	Yes, Alstom make P442, Numerical	Yes, Directional P141, Areva make	No	Yes, P442 Relay	Yes, P442 Relay	No	1	Yes, P442 & P141Relay	Yes, P442 & P141Relay	Yes, P442 Relay
16	Umiam St I (Sumer) - Mawngap II	132	Umiam St I (Sumer)										
			Mawngap	Yes, Alstom make P442, Numerical	Yes, Directional P141, Areva make	No	Yes, P442 Relay	Yes, P442 Relay	No	1	Yes, P442 & P141Relay	Yes, P442 & P141Relay	Yes, P442 Relay
17	Mawlai - Mawngap I	132	Mawlai	Yes, Areva make P442, Numerical	Yes, Directional P127 Areva make	No	Yes, P442 Relay	Yes, P442 Relay	No	1	Yes, P442 & P127 Relay	Yes, P442 & P127 Relay	Yes, P442 Relay
			Mawngap	Yes, Alstom make P442, Numerical	Yes, Directional P141, Areva make	No	Yes, P442 Relay	Yes, P442 Relay	No	1	Yes, P442 & P141Relay	Yes, P442 & P141Relay	Yes, P442 Relay

132 kV Transmission Line Protection Details

Annexure-A.8 (II)

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details							Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) Over Current & Earth Fault Relay exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes / No)	Carrier aided Inter-tripping exists (Yes / No)	Power Swing Blocking Feature exists (Yes / No)	Pole Discrepancy Relay exists (Yes / No)	Number of Core used for CT & VT, used for Main I	Disturbance Recorder exists (Yes / No)	Event Logger / Sequential Event Recorder exists (Yes / No)	Fault Locator exists (Yes / No)
18	Nongstoin - Mawngap	132	Nongstoin	No	No	No	No	0	No	No	No		
			Mawngap	Yes, Alstom make P442, Numerical	Yes, Directional P141, Areva make	No	Yes, P442 Relay	Yes, P442 Relay	No	1	Yes, P442 & P141Relay	Yes, P442 & P141Relay	Yes, P442 Relay
19	Nongstoin - Nangalbibra	132	Nongstoin	Yes, Areva make P442, Numerical	Yes, Directional P127, Areva make	No	Yes, P442 Relay	Yes, P442 Relay	No	1	Yes, P442 & P127 Relay	Yes, P442 & P127 Relay	Yes, P442 Relay
			Nangalbibra	Yes, Areva make P442, Numerical	Yes, Directional P127, Areva make	No	Yes, P442 Relay	Yes, P442 Relay	No	1	Yes, P442 & P127 Relay	Yes, P442 & P127 Relay	Yes, P442 Relay
20	Khliehriat - NEHU	132	Khliehriat	Yes, Areva make P442, Numerical	Yes, Directional CDD, EE make	No	Yes, P442 Relay	Yes, P442 Relay	No	1	Yes, P442 Relay	Yes, P442 Relay	Yes, P442 Relay
			NEHU	Yes, Areva make P442, Numerical	Yes, Directional P127 Areva make	No	Yes, P442 Relay	Yes, P442 Relay	No	1	Yes, P442 & P127 Relay	Yes, P442 & P127 Relay	Yes, P442 Relay
21	Khliehriat - NEIGRIHMS	132	Khliehriat	Yes, ABB make REL670, Numerical	Yes, Directional CDD, EE make	No	Yes, REL670 Relay	Yes, REL670 Relay	No	1	Yes, REL670 Relay	Yes, REL670 Relay	Yes, REL670 Relay
			NEIGRIHMS	Yes, Areva make P442, Numerical	Yes, Directional CDD, EE make	No	Yes, P442 Relay	Yes, P442 Relay	No	1	Yes, P442 Relay	Yes, P442 Relay	Yes, P442 Relay
22	NEIGRIHMS - NEHU	132	NEIGRIHMS	No	Yes, Directional CDD, EE make	No	No	No	No	0	No	No	No
			NEHU	Yes, EE make RR3V, EM	Yes, Directional P127 Areva make	No	No	No	No	1	Yes, P127 Relay	Yes, P127 Relay	No
23	Nangalbibra - Rongkhon (Tura)	132	Nangalbibra	Yes, Areva make P442, Numerical	Yes, Directional P127, Areva make	No	Yes, P442 Relay	Yes, P442 Relay	No	1	Yes, P442 & P127 Relay	Yes, P442 & P127 Relay	Yes, P442 Relay
			Rongkhon (Tura)	No	Yes, Directional P127, Areva make	No	No	No	No	0	Yes, P127 Relay	Yes, P127 Relay	No

132 kV Transmission Line Protection Details

Annexure-A.8 (II)

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details							Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) Over Current & Earth Fault Relay exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes / No)	Carrier aided Inter-tripping exists (Yes / No)	Power Swing Blocking Feature exists (Yes / No)	Pole Discrepancy Relay exists (Yes / No)	Number of Core used for CT & VT, used for Main I	Disturbance Recorder exists (Yes / No)	Event Logger / Sequential Event Recorder exists (Yes / No)	Fault Locator exists (Yes / No)
24	Lumshnong - Khliehriat	132	Lumshnong	No	Yes, Directional IDMTL, ER make	No	No	No	No	0	No	No	No
			Khliehriat	Yes, Areva make P442, Numerical	Yes, Directional CDD, EE make	No	Yes, P442 Relay	Yes, P442 Relay	No	1	Yes, P442 Relay	Yes, P442 Relay	Yes, P442 Relay
25	Sohra (Cherrapunjee) - Mawlai	132	Sohra (Cherrapunjee)										
			Mawlai	Yes, Areva make P442, Numerical	Yes, Directional P127 Areva make	No	Yes, P442 Relay	Yes, P442 Relay	No	1	Yes, P442 & P127 Relay	Yes, P442 & P127 Relay	Yes, P442 Relay
26	Umiam St I (Sumer) - Umiam	132	Umiam St I (Sumer)	Yes, Areva make P442, Numerical	Yes, Directional P141, Areva make	No	Yes, P442 Relay	Yes, P442 Relay	No	1	Yes, P442 & P141Relay	Yes, P442 & P141Relay	Yes, P442 Relay
			Umiam	Yes, Toshiba make GRZ100, numerical	Yes, Directional JNP066, JVS make	No	Yes, GRZ100 Relay	Yes, GRZ100 Relay	No	1	Yes, GRZ 100 Relay	Yes, GRZ 100 Relay	Yes, GRZ100 Relay
27	Umiam - NEHU	132	Umiam	No	Yes, Directional JNP066, JVS make	No	No	No	No	0	No	No	No
			NEHU	Yes, EE make RR3V, EM	Yes, Directional P127 Areva make	No	No	No	No	1	Yes, P127 Relay	Yes, P127 Relay	No
28	Umiam St I (Sumer) - Mawlai	132	Umiam St I (Sumer)	Yes, Areva make P442, Numerical	Yes, Directional P141, Areva make	No	Yes, P442 Relay	Yes, P442 Relay	No	1	Yes, P442 & P141Relay	Yes, P442 & P141Relay	Yes, P442 Relay
			Mawlai	Yes, Areva make P442, Numerical	Yes, Directional P127 Areva make	No	Yes, P442 Relay	Yes, P442 Relay	No	1	Yes, P442 & P127 Relay	Yes, P442 & P127 Relay	Yes, P442 Relay
29	Umiam St III (Kyrdemkulai) - Umiam St IV - I (Nongkhyllem)	132	Umiam St III (Kyrdemkulai)	Yes, ABB make REL670, Numerical	Yes, Directional P127, Areva make	No	Yes, REL670 Relay	Yes, REL670 Relay	No	1	Yes, REL670 & P127 Relay	Yes, REL670 & P127 Relay	Yes, REL670 Relay
			Umiam St IV (Nongkhyllem)	Yes, ABB make REL670, Numerical	Yes, Directional P127, Areva make	No	Yes, REL670 Relay	Yes, REL670 Relay	No	1	Yes, REL670 & P127 Relay	Yes, REL670 & P127 Relay	Yes, REL670 Relay

132 kV Transmission Line Protection Details

Annexure-A.8 (II)

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details							Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) Over Current & Earth Fault Relay exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes / No)	Carrier aided Inter-tripping exists (Yes / No)	Power Swing Blocking Feature exists (Yes / No)	Pole Discrepancy Relay exists (Yes / No)	Number of Core used for CT & VT, used for Main I	Disturbance Recorder exists (Yes / No)	Event Logger / Sequential Event Recorder exists (Yes / No)	Fault Locator exists (Yes / No)
39	EPH 1- Megha Carbides	132	Megha Carbides										
40	Lumshnong - CMCL	132	Lumshnong	No	Yes, Directional CDD, ER make	No	No	No	No	0	No	No	No
			CMCL										
41	Lumshnong - MCL	132	Lumshnong	No	Yes, Directional JNC069, JVS make	No	No	No	No	0	No	No	No
			MCL										
42	Lumshnong - Adhunik Cement	132	Lumshnong	No	Yes, Directional JNC069, JVS make	No	No	No	No	0	No	No	No
			Adhunik Cement										
43	Lumshnong - Hill Cement	132	Lumshnong	No	Yes, Directional JNC069, JVS make	No	No	No	No	0	No	No	No
			Hill Cement										
44	Lumshnong - JUD Cement	132	Lumshnong	No	Yes, Directional JNC069, JVS make	No	No	No	No	0	No	No	No
			JUD Cement										
45	Lumshnong - GVIL Cement	132	Lumshnong										
			GVIL Cement										
46	MPL (Meghalaya Power Limited) - Lumshnong	132	MPL (Meghalaya Power Limited)										
			Lumshnong	No	Yes, Directional P127 Areva make	No	No	No	No	0	No	No	No
47	Sohra (Cherrapunjee) - Mawngap	132	Sohra (Cherrapunjee)	No	Yes, Directional P127, Areva make	No	No	No	No	0	Yes, P127 Relay	Yes, P127 Relay	No
			Mawngap	Yes, Alstom make P442, Numerical	Yes, Directional P141, Areva make	No	Yes, P442 Relay	Yes, P442 Relay	No	1	Yes, P442 & P141Relay	Yes, P442 & P141Relay	Yes, P442 Relay

132 kV Transmission Line Protection Details

Annexure-A.8 (II)

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details							Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) Over Current & Earth Fault Relay exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes / No)	Carrier aided Inter-tripping exists (Yes / No)	Power Swing Blocking Feature exists (Yes / No)	Pole Discrepancy Relay exists (Yes / No)	Number of Core used for CT & VT, used for Main I	Disturbance Recorder exists (Yes / No)	Event Logger / Sequential Event Recorder exists (Yes / No)	Fault Locator exists (Yes / No)

4. Owner of Line/End: P&E, Mizoram

1	Bairabi - Kolasib	132	Bairabi	Micom P430A	Yes	No	No	No	No	4	No	No	No
			Kolasib	No	No	No	No	No	No		No	No	No
2	Zuangtui (Zemabawk) - Bukpui (Serchhip)	132	Zuangtui (Zemabawk)	No	No	No	No	No	No		No	No	No
			Bukpui (Serchhip)	No	No	No	No	No	No		No	No	No
3	Bukpui (Serchhip) - Khawiva (Lunglei)	132	Bukpui (Serchhip)	No	No	No	No	No	No		No	No	No
			Khawiva (Lunglei)	No	No	No	No	No	No		No	No	No
4	Zuangtui (Zemabawk) - Saitual	132	Zuangtui (Zemabawk)	No	Yes (EM)	No	No	No	No		No	No	No
			Saitual	No	Yes (EM)	No	No	No	No		No	No	No
5	Saitual - Khawzawl	132	Saitual	No	Yes (EM)	No	No	No	No		No	No	No
			Khawzawl	No	No	No	No	No	No		No	No	No

5. Owner of Line/End: NEEPCO

1	Khandong - Kopili -I	132	Khandong										
			Kopili										
2	Khandong - Kopili - II	132	Khandong	Yes, REL 670	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
			Kopili	Yes, REL 670	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	

6. Owner of Line/End: POWERGRID

1	Badarpur- Jiribam	132	Badarpur (PG)	Yes, MICOM P442	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
			Jiribam (PG)	Yes, 7SA513	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
2	Aizawl-Kumarghat	132	Aizawl (PG)	Yes, MICOM P442	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
			Kumarghat (PG)	Yes, MICOM P442	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
3	Badarpur - Khliehriat	132	Badarpur (PG)	Yes, MICOM P442	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
			Khliehriat (PG)	Yes, MICOM P442	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
4	Badarpur-Kumarghat	132	Badarpur (PG)	Yes, MICOM P442	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
			Kumarghat (PG)	Yes, 7SA513	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	

132 kV Transmission Line Protection Details

Annexure-A.8 (II)

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details							Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) Over Current & Earth Fault Relay exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes / No)	Carrier aided Inter-tripping exists (Yes / No)	Power Swing Blocking Feature exists (Yes / No)	Pole Discrepancy Relay exists (Yes / No)	Number of Core used for CT & VT, used for Main I	Disturbance Recorder exists (Yes / No)	Event Logger / Sequential Event Recorder exists (Yes / No)	Fault Locator exists (Yes / No)
13	Bodhjungnagar-SMNagar	132	Bodhjungnagar	Yes	Yes	No	No	Yes	No	3 & 2-Core	No	No	No
			SMNagar	Yes	Yes	No	No	Yes	No	3 & 2-Core	No	No	No
14	SMNagar-Grid	132	SMNagar	Yes	Yes	No	No	Yes	No	3 & 2-Core	No	No	No
			Grid	No	No	No	No	No	No	No	No	No	No
15	PKBari-Gournagar	132	PKBari	No	No	No	No	No	No	No	No	No	No
			Gournagar	No	No	No	No	No	No	No	No	No	No
16	PKBari-Missiontilla	132	PKBari	No	No	No	No	No	No	No	No	No	No
			Missiontilla	Yes	Yes	No	No	Yes	No	3 & 2-Core	No	No	No

Note : 1) Main-I Protection indicates Distance Protection

2) Main-II Protection indicates one of Distance Protection / Directional Comparison Protection / Phase Segregated Line Differential protection

3) Type of Relay indicates it's operational mechanism - Numerical / Static / Electro-mechanical

4) List of inbuilt features of Numerical Relays are also to be furnished alongwith this format

132 kV Transmission Line Protection Details

Annexure-II

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details							Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) Over-Current & Earth Fault Relay exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes / No)	Carrier aided Inter-tripping exists (Yes / No)	Power Swing Blocking Feature exists (Yes / No)	Pole Discrepancy Relay exists (Yes / No)	Number of Core used for CT & VT, used for Main I	Disturbance Recorder exists (Yes / No)	Event Logger / Sequential Event Recorder exists (Yes / No)	Fault Locator exists (Yes / No)
I. Owner of End : Assam & Meghalaya													
1	Kahilipara-Umtru I	132	Kahilipara	Yes (7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Umtru	Yes, Directional JNP096, JVS make	No	Yes, GRZ100 Relay	Yes, GRZ100 Relay	No	1	Yes, GRZ100 Relay	Yes, GRZ100 Relay	Yes, GRZ100 Relay	
2	Kahilipara-Umtru II	132	Kahilipara	Yes (7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Umtru	Yes, Directional JNP096, JVS make	No	Yes, GRZ100 Relay	Yes, GRZ100 Relay	No	1	Yes, GRZ100 Relay	Yes, GRZ100 Relay	Yes, GRZ100 Relay	
3	Panchgram-Khliehriat	132	Panchgram	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Khliehriat	NoT KNoWN									
4	Panchgram-Lumshnong	132	Panchgram	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Lumshnong	Yes, Areva make P442, Numerical	Non directional CDG, EE make	No	Yes, P442 Relay	Yes, P442 Relay	No	1	Yes, P442 Relay	Yes, P442 Relay	Yes, P442 Relay
5	Sarusajai-Umtru	132	Sarusajai	Yes(THR ER)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Umtru	Yes, Areva make P442, Numerical	Yes, Directional CDD, EE make	No	Yes, P442 Relay	Yes, P442 Relay	No	1	Yes, P442 Relay	Yes, P442 Relay	Yes, P442 Relay
6	Sarusajai-Umiam Stg IV	132	Sarusajai	Yes(THR ER)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Umiam Stg IV	Yes, Areva make P442, Numerical	Yes, Directional CDD, EE make	No	Yes, P442 Relay	Yes, P442 Relay	No	1	Yes, P442 Relay	Yes, P442 Relay	Yes, P442 Relay
7	Agia - Nangalbibra	132	Agia										
			Nangalbibra	No	Yes, Directional P127, Areva make	No	No	No	No	0	Yes, P127 Relay	Yes P127 Relay	No

132 kV Transmission Line Protection Details

Annexure-II

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details							Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) Over-Current & Earth Fault Relay exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes / No)	Carrier aided Inter-tripping exists (Yes / No)	Power Swing Blocking Feature exists (Yes / No)	Pole Discrepancy Relay exists (Yes / No)	Number of Core used for CT & VT, used for Main I	Disturbance Recorder exists (Yes / No)	Event Logger / Sequential Event Recorder exists (Yes / No)	Fault Locator exists (Yes / No)
2. Owner of End : Assam & POWERGRID													
1	Mokokchung-Mariani	132	Mokokchung (PG)	Not KNown									
			Mariani	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
2	Pailapool-Jiribam(PG)	132	Pailapool	Yes(7SA SIEMENS)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
			Jiribam(PG)	Yes, MICOM P442	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
3	Dimapur (PG) - Bokajan	132	Dimapur(PG)	Yes, MICOM P442	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
			Bokajan	Yes(THR ER)	Yes (IDMTL)	No	No	Yes	Yes	1	Yes	Yes	Yes
4	Badarpur (PG) - Badarpur		Badarpur (PG)	Yes, MICOM P442	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
			Badarpur	Yes, MICOM	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
5	Balipara (PG)-Gohpur		Balipara (PG)	Yes, 7SA522	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
			Gohpur										
6	Gohpur - Nirjuli		Gohpur										
			Nirjuli (PG)	Yes, MICOM	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
7	Haflong (PG)-Haflong		Haflong (PG)	Yes, P442	Yes, P141	Yes	Yes		Yes		Yes	Yes	
			Haflong										
8	Silchar (PG)-Hailakandi I		Silchar (PG)	Yes, MICOM P442	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
			Hailakandi										
9	Silchar (PG)-Hailakandi II		Silchar (PG)	Yes, MICOM	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
			Hailakandi										
10	Silchar (PG)- Srikona I		Silchar (PG)	Yes, MICOM P543	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	

132 kV Transmission Line Protection Details

Annexure-II

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details							Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) Over-Current & Earth Fault Relay exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes / No)	Carrier aided Inter-tripping exists (Yes / No)	Power Swing Blocking Feature exists (Yes / No)	Pole Discrepancy Relay exists (Yes / No)	Number of Core used for CT & VT, used for Main I	Disturbance Recorder exists (Yes / No)	Event Logger / Sequential Event Recorder exists (Yes / No)	Fault Locator exists (Yes / No)
			Srikona										
11	Silchar (PG)- Srikona II		Silchar (PG)	Yes, MICOM P543	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
			Srikona										
3. Owner of End : Manipur & POWERGRID													
1	Imphal(Manipur) - Imphal(PG) I	132	Imphal (Manipur)	Yes	Yes	Yes	No	No	Yes	4 & 3	No	No	No
			Imphal(PG)	Yes, O/C	Yes, O/C & EF	Yes	Yes		Yes	Yes	Yes	Yes	Yes
2	Imphal(Manipur) - Imphal(PG) II	132	Imphal (Manipur)	Yes	Yes	Yes	No	No	Yes	4 & 3	No	No	No
			Imphal(PG)	Yes, P543 (Differential)	Yes, O/C & EF	Yes	Yes		Yes	Yes	Yes	Yes	Yes
3	Imphal(PG) - Ningthoukhong	132	Imphal(PG)										
			Ningthoukhong	Yes	Yes	Yes	No	No	Yes	4 & 3	No	No	No
4	Jiribam (PG) - Jiribam (Manipur)	132	Jiribam (PG)										
			Jiribam (Manipur)	Yes	Yes	Yes	No	No	Yes	4 & 3	No	No	No
5	Jiribam (PG) - Rengpang	132	Jiribam (PG)	Yes, MICOM P442	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
			Rengpang										
4. Owner of End : Manipur & NHPC													
1	Loktak - Rengpang	132	Loktak	Yes, Numerical MICOM P442	Yes, (EM relay in addition to Numerical Relay)	Feature exists in SF6 breaker & Numerical Relay	No	Yes	Yes	1 core each	Yes	Yes	Yes
			Rengpang	Yes	Yes	Yes	No	No	Yes	4 & 3	No	No	No
2	Loktak - Ningthoukhong	132	Loktak	Yes, Numerical MICOM P442	Yes, (EM relay in addition to Numerical Relay)	Feature exists in SF6 breaker & Numerical Relay	No	Yes	Yes	1 core each	Yes	Yes	Yes
			Ningthoukhong	Yes	Yes	Yes	No	No	Yes	4 & 3	No	No	No

132 kV Transmission Line Protection Details

Annexure-II

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details							Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) Over-Current & Earth Fault Relay exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes / No)	Carrier aided Inter-tripping exists (Yes / No)	Power Swing Blocking Feature exists (Yes / No)	Pole Discrepancy Relay exists (Yes / No)	Number of Core used for CT & VT, used for Main I	Disturbance Recorder exists (Yes / No)	Event Logger / Sequential Event Recorder exists (Yes / No)	Fault Locator exists (Yes / No)
5. Owner of End : MePTCL & POWERGRID													
1	Khliehriat - Khliehriat (Meghalaya) I	132	Khliehriat (Meghalaya)	Yes, Areva make P442, Numerical	Yes, Directional CDD, EE make	No	Yes, P442 Relay	Yes, P442 Relay	No	1	Yes, P442 Relay	Yes, P442 Relay	Yes, P442 Relay
			Khliehriat (PG)	Yes, MICOM P442	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
2	Khliehriat - Khliehriat (Meghalaya) II	132	Khliehriat (Meghalaya)	No	Yes, Directional P127 Areva make	No	No	No	No	0	Yes, P127 Relay	Yes, P127 Relay	No
			Khliehriat (PG)										
6. Owner of End: P&E, Mizoram & POWERGRID													
1	Badarpur - Kolasib	132	Badarpur (PG)	Yes, MICOM P442	Yes, O/C & E/F	Yes	Yes		Yes		Yes	Yes	
			Kolasib	Yes, 7SA513	Yes, O/C & E/F	Yes	Yes		Yes		Yes	Yes	
2	Kolasib - Aizwal	132	Kolasib	Yes, 7SA513	Yes, O/C & E/F	Yes	Yes		Yes		Yes	Yes	
			Aizwal (PG)	Yes, 7SA513	Yes, O/C & E/F	Yes	Yes		Yes		Yes	Yes	
3	Aizwal - Luangmual	132	Aizwal (PG)										
			Luangmual										
4	Zuangtui (Zemabawk) - Aizwal I	132	Zuangtui (Zemabawk)	No	No	No	No	No	No		No	No	No
			Aizwal (PG)	Yes, 7SA513	Yes, O/C & E/F	Yes	Yes		Yes		Yes	Yes	
5	Zuangtui (Zemabawk) - Aizwal II	132	Zuangtui (Zemabawk)	No	No	No	No	No	No		No	No	No
			Aizwal (PG)	Yes, REL 670	Yes, O/C & E/F	Yes	Yes		Yes		Yes	Yes	

132 kV Transmission Line Protection Details

Annexure-II

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details							Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) Over-Current & Earth Fault Relay exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes / No)	Carrier aided Inter-tripping exists (Yes / No)	Power Swing Blocking Feature exists (Yes / No)	Pole Discrepancy Relay exists (Yes / No)	Number of Core used for CT & VT, used for Main I	Disturbance Recorder exists (Yes / No)	Event Logger / Sequential Event Recorder exists (Yes / No)	Fault Locator exists (Yes / No)
7. Owner of End: NEEPCO & POWERGRID													
1	Ranganadi-Nirjuli	132	Rangandi	Semi Numerical, EPAC 3000, Make- Alstom	Yes	Yes (Three Phase)	No	Yes	No	Core-1 of CT & CVT are used for Main-1	No	No	No
			Nirjuli (PG)	Yes, MICOM	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
2	Ranganadi-Ziro	132	Rangandi	Semi Numerical, EPAC 3000, Make- Alstom	Yes	Yes (Three Phase)	No	Yes	No	Core-1 of CT & CVT are used for Main-1	No	No	No
			Ziro (PG)	Yes, MICOM P442	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
3	AGTPP- Kumarghat	132	AGTPP	OPTIMHO (LFZP111S1 0053E) Make: GEC ALSTOM	No, Directional Inverse type –CDD relay exists	Facility exists but not in service	Yes	Yes	Yes	Core-1 of CT & CVT are used for Main-1	No	No	No
			Kumarghat (PG)	Yes, 7SA513	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
4	Balipara-Khupi	132	Balipara (PG)	Yes, SEL311C	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
			Khupi										
5	Doyang - Dimapur-I	132	Doyang	Static relay- REL-100, ABB Make	Relay-2TJM-12 (Easun Reyrole)		Yes	No	Yes		Yes		
			Dimapur(PG)	Yes, MICOM P442	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	

132 kV Transmission Line Protection Details

Annexure-II

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details							Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) Over-Current & Earth Fault Relay exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes / No)	Carrier aided Inter-tripping exists (Yes / No)	Power Swing Blocking Feature exists (Yes / No)	Pole Discrepancy Relay exists (Yes / No)	Number of Core used for CT & VT, used for Main I	Disturbance Recorder exists (Yes / No)	Event Logger / Sequential Event Recorder exists (Yes / No)	Fault Locator exists (Yes / No)
6	Doyang - Dimapur-II	132	Doyang	Static relay-REL-100, ABB Make	Relay-2TJM-12 (Easun Reyrole)		Yes	No	Yes		Yes		
			Dimapur(PG)	Yes, MICOM P442	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
7	Khandong - Haflong	132	Khandong										
			Haflong (PG)	Yes, MICOM P442	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
8	Khandong - Khliehriat I	132	Khandong										
			Khliehriat (PG)	Yes, MICOM P442	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
9	Khandong - Khliehriat II	132	Khandong	Yes, 7SA513	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
			Khliehriat (PG)	Yes, MICOM P442	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
8. Owner of End: NEEPCO & TSECL													
1	132 kV AGTPP-Agartala I	132 kV	AGTPP	OPTIMHO (LFZP111S1 0053E) Make: GEC ALSTOM	No, Directional Inverse type –CDD relay exists	Facility exists but not in service	Yes	Yes	Yes	Core-1 of CT & CVT are used for Main-1	No	No	No
			Agartala	OPTIMHO		Yes	Yes		Yes		No	No	
2	132 kV AGTPP-Agartala II	132 kV	AGTPP	OPTIMHO (LFZP111S1 0053E) Make: GEC ALSTOM	No, Directional Inverse type –CDD relay exists	Facility exists but not in service	Yes	Yes	Yes	Core-1 of CT & CVT are used for Main-1	No	No	No
			Agartala	OPTIMHO		Yes	Yes				No	No	

132 kV Transmission Line Protection Details

Annexure-II

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details							Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) Over-Current & Earth Fault Relay exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes / No)	Carrier aided Inter-tripping exists (Yes / No)	Power Swing Blocking Feature exists (Yes / No)	Pole Discrepancy Relay exists (Yes / No)	Number of Core used for CT & VT, used for Main I	Disturbance Recorder exists (Yes / No)	Event Logger / Sequential Event Recorder exists (Yes / No)	Fault Locator exists (Yes / No)
12. Owner of End : POWERGRID & TSECL													
1	Silchar-P.K.Bari-1	132	Silchar (PG)	Yes, MICOM P442	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
			P.K. Bari										
2	Silchar- P.K.Bari-2	132	Silchar (PG)	Yes, MICOM P442	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
			P.K. Bari										
13. Owner of End : POWERGRID & DoP, Arunachal Pradesh													
1	Ziro-Daporijo	132	Ziro (PG)	Yes, SEL 311C	Yes, O/C & EF	Yes	Yes		Yes		Yes	Yes	
			Daporijo										
14. Owner of End : NEEPCO & DoP, Nagaland													
1	Doyang- Mokokchung	132	Doyang	Static relay- REL-100, ABB Make	Relay-2TJM-12 (Easun Reyrole)		Yes	No	Yes		Yes		
			Mokokchung										
2	Doyang- Kohima	132	Doyang	Static relay- REL-100, ABB Make	Relay-2TJM-12 (Easun Reyrole)		Yes	No	Yes		Yes		
			Kohima										
15. Owner of End : NEEPCO & TSECL													
1	Missiontilla-ASEB	132	Missiontilla	No	No	No	No	No	No	No	No	No	No
			ASEB										
2	Banduar- Palatana	132	Banduar	Yes	Yes	No	No	Yes	No	3 & 2-Core	No	No	No
			Palatana										
3	Banduar- Monarchak	132	Banduar	Yes	Yes	No	No	Yes	No	3 & 2-Core	No	No	No
			Monarchak										
4	Rokhia-Monarchak	132	Rokhia	Yes	Yes	No	No	Yes	No	3 & 2-Core	No	No	No
			Monarchak										
Note : 1) Main-I Protection indicates Distance Protection 2) Main-II Protection indicates one of Distance Protection / Directional Comparison Protection / Phase Segregated Line Differential protection 3) Type of Relay indicates it's operational mechanism - Numerical / Static / Electro-mechanical 4) List of inbuilt features of Numerical Relays are also to be furnished alongwith this format													

220 kV Transmission Line Protection Details

Annexure II

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details										Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Main II Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) type Earth Fault Relay exists (Yes/No)	Two stage Over-Voltage Protection exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes/No)	Carrier aided Inter-tripping exists (Yes/No)	Power Swing Blocking Feature exists (Yes/No)	Pole Discrepancy Relay exists (Yes/No)	Number of Core used for CT & VT, used for Main I	Number of Core used for CT & VT, used for Main II	Disturbance Recorder exists (Yes/No)	Event Logger / Sequential Event Recorder exists (Yes/No)	Fault Locator exists (Yes/No)
12	Langpi- Sarusajai I	220	Langpi	Yes(7SA52 SIEMENS)	No	Yes(IDMT)	No	No	No	Yes	Yes	1	1	Yes	Yes	Yes
			Sarusajai I	Yes(7SA52 SIEMENS)	No	Yes(IDMT)	No	No	No	Yes	Yes	1	1	Yes	Yes	Yes
13	Langpi- Sarusajai II	220	Langpi	Yes(7SA52 SIEMENS)	No	Yes(IDMT)	No	No	No	Yes	Yes	1	1	Yes	Yes	Yes
			Sarusajai II	Yes(7SA52 SIEMENS)	No	Yes(IDMT)	No	No	No	Yes	Yes	1	1	Yes	Yes	Yes
14	CMCL - Karbi Langpi	220	CMCL	Not KNown												
			Karbi Langpi	Yes(7SA52 SIEMENS)	No	Yes(IDMT)	No	No	No	Yes	Yes	1	1	Yes	Yes	Yes
15	Sarusajai - CMCL	220	Sarusajai	Yes(7SA52 SIEMENS)	No	Yes(IDMT)	No	No	No	Yes	Yes	1	1	Yes	Yes	Yes
			CMCL	Not KNown												
16	Mariani-Samaguri I	220	Mariani													
			Samaguri I													
17	Mariani-Samaguri II	220	Mariani	Yes(7SA52 SIEMENS)	No	Yes(IDMT)	No	No	No	Yes	Yes	1	1	Yes	Yes	Yes
			Samaguri II	Yes(7SA52 SIEMENS)	No	Yes(IDMT)	No	No	No	Yes	Yes	1	1	Yes	Yes	Yes
18	Salakati-Harigaon I	220	Salakari	Yes(7SA52 SIEMENS)	No	Yes(IDMT)	No	No	No	Yes	Yes	1	1	Yes	Yes	Yes
			Harigaon I	Not KNown												
19	Salakati-Harigaon II	220	Salakari	Yes(7SA52 SIEMENS)	No	Yes(IDMT)	No	No	No	Yes	Yes	1	1	Yes	Yes	Yes
			Harigaon II	Not KNown												
20	Samaguri-Balipara	220	Samaguri	Yes(7SA52 SIEMENS)	Yes(P442 MICOM)	Yes(IDMT)	No	No	No	Yes	Yes	1	1	Yes	Yes	Yes
			Balipara	PGCIL	PGCIL	Yes(IDMT)	No	No	No	Yes	Yes	1	1	Yes	Yes	Yes
21	Samaguri-Sarusajai I	220	Samaguri													
			Sarusajai I													
22	Samaguri - Jawahar Nagar	220	Samaguri	Yes(7SA52 SIEMENS)	No	Yes(IDMT)	No	No	Yes	Yes	Yes	1	1	Yes	Yes	Yes
			Jawahar Nagar	Yes(L-PRO ER)	Yes(L-PRO ER)	Yes(IDMT)	No	Yes(1-PH)	Yes	Yes	Yes	1	1	Yes	Yes	Yes

220 kV Transmission Line Protection Details

Annexure II

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details										Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Main II Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) type Earth Fault Relay exists (Yes/No)	Two stage Over-Voltage Protection exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes/No)	Carrier aided Inter-tripping exists (Yes/No)	Power Swing Blocking Feature exists (Yes/No)	Pole Discrepancy Relay exists (Yes/No)	Number of Core used for CT & VT, used for Main I	Number of Core used for CT & VT, used for Main II	Disturbance Recorder exists (Yes/No)	Event Logger / Sequential Event Recorder exists (Yes/No)	Fault Locator exists (Yes/No)
23	Jawahar Nagar - Sarusajai	220	Jawahar Nagar	Yes(L-PRO ER)	Yes(L-PRO ER)	Yes(IDMT)	No	Yes(1-PH)	Yes	Yes	Yes	1	1	Yes	Yes	Yes
			Sarusajai	Yes(7SA52 SIEMENS)	No	Yes(IDMT)	No	No	Yes	Yes	Yes	1	1	Yes	Yes	Yes
24	Samaguri-Sarusajai II	220	Samaguri	Yes(7SA52 SIEMENS)	No	Yes(IDMT)	No	No	No	Yes	Yes	1	1	Yes	Yes	Yes
			Sarusajai II	Yes(7SA52 SIEMENS)	No	Yes(IDMT)	No	No	No	Yes	Yes	1	1	Yes	Yes	Yes
25	Tinsukia-AGBPP I	220	Tinsukia	Yes(7SA SIEMENS)	No	Yes(IDMT)	No	No	No	Yes	Yes	1	1	Yes	Yes	Yes
			AGBPP I	Yes(SEL-321 SWITZER)	Yes(7SA SIEMENS)	Yes(IDMT)	No	Yes(1-PH)	No	Yes	Yes	1	1	Yes	Yes	Yes
26	Tinsukia-AGBPP II	220	Tinsukia	Yes(SEL-321 SWITZER)	No	Yes(IDMT)	No	No	No	Yes	Yes	1	1	Yes	Yes	Yes
			AGBPP II	Yes(SEL-321 SWITZER)	Yes(7SA SIEMENS)	Yes(IDMT)	No	No	No	Yes	Yes	1	1	Yes	Yes	Yes
27	Tinsukia-Namrup I	220	Tinsukia	Yes(7SA52 SIEMENS)	No	Yes(IDMT)	No	No	No	Yes	Yes	1	1	Yes	Yes	Yes
			Namrup I	Yes(7SA61 SIEMENS)	No	Yes(IDMT)	No	No	No	Yes	Yes	1	1	Yes	Yes	Yes
28	Tinsukia-Namrup II	220	Tinsukia	Yes(7SA52 SIEMENS)	No	Yes(IDMT)	No	No	No	Yes	Yes	1	1	Yes	Yes	Yes
			Namrup II	Yes(7SA61 SIEMENS)	No	Yes(IDMT)	No	No	No	Yes	Yes	1	1	Yes		Yes

2. Owner of Line/End: Meghalaya, MePTCL

1	Misa - Killing (Byrnihat) I	220	Misa													
			Killing (Byrnihat)	Yes, ABB make REL670, Numerical	Yes, Areva make P442, Numerical	Yes	Yes	Yes, REL670 & P442 Relay	Yes, REL670 & P442 Relay	Yes, REL670 & P442 Relay	Yes	1	1	Yes, REL670 & P442 Relay	Yes, REL670 & P442 Relay	Yes, REL670 & P442 Relay
2	Misa - Killing (Byrnihat) II	220	Misa													
			Killing (Byrnihat)	Yes, ABB make REL670, Numerical	Yes, Areva make P442, Numerical	Yes	Yes	Yes, REL670 & P442 Relay	Yes, REL670 & P442 Relay	Yes, REL670 & P442 Relay	Yes	1	1	Yes, REL670 & P442 Relay	Yes, REL670 & P442 Relay	Yes, REL670 & P442 Relay

220 kV Transmission Line Protection Details

Annexure II

Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details										Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Main II Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) type Earth Fault Relay exists (Yes/No)	Two stage Over-Voltage Protection exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes/No)	Carrier aided Inter-tripping exists (Yes/No)	Power Swing Blocking Feature exists (Yes/No)	Pole Discrepancy Relay exists (Yes/No)	Number of Core used for CT & VT, used for Main I	Number of Core used for CT & VT, used for Main II	Disturbance Recorder exists (Yes/No)	Event Logger / Sequential Event Recorder exists (Yes/No)	Fault Locator exists (Yes/No)
3. Owner of Line/End: POWERGRID																
1	Misa - Dimapur I	220	Misa (PG)	Yes, MICOM P442	Yes, 7SA513			Yes	Yes		Yes			Yes	Yes	
			Dimapur (PG)	Yes, MICOM P442	Yes, 7SA513			Yes	Yes		Yes			Yes	Yes	
2	Misa - Dimapur II	220	Misa (PG)	Yes, MICOM P442	Yes, 7SA513			Yes	Yes		Yes			Yes	Yes	
			Dimapur (PG)	Yes, MICOM P442	Yes, 7SA513			Yes	Yes		Yes			Yes	Yes	
3	Salakti - Birpara I	220	Salakati (PG)	Yes, MICOM P442	Yes, 7SA522			Yes	Yes		Yes			Yes	Yes	
			Birpara (PG)													
4	Salakti - Birpara II	220	Salakati (PG)	Yes, MICOM P442	Yes, 7SA522			Yes	Yes		Yes			Yes	Yes	
			Birpara (PG)													
5	Misa - Mariani (PG)	220	Misa (PG)	Yes, SIEMENS 7SA522	Yes, MICOM P442			Yes	Yes		Yes			Yes	Yes	
			Mariani (PG)	Yes, MICOM P444	Yes, REL 670			Yes	Yes		Yes			Yes	Yes	

Note 1) Main-I Protection indicates Distance Protection

2) Main-II Protection indicates one of Distance Protection / Directional Comparison Protection / Phase Segregated Line Differential protection

3) Type of Relay indicates it's operational mechanism - Numerical / Static / Electro-mechanical

4) List of inbuilt features of Numerical Relays are also to be furnished alongwith this

220 kV Transmission Line Protection Details														Annexure II		
Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details										Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Main II Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) type Earth Fault Relay exists (Yes/No)	Two stage Over-Voltage Protection exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes/No)	Carrier aided Inter-tripping exists (Yes/No)	Power Swing Blocking Feature exists (Yes/No)	Pole Discrepancy Relay exists (Yes/No)	Number of Core used for CT & VT, used for Main I	Number of Core used for CT & VT, used for Main II	Disturbance Recorder exists (Yes/No)	Event Logger / Sequential Event Recorder exists (Yes/No)	Fault Locator exists (Yes/No)
3. Owner of End: Meghalaya, MePTCL & POWERGRID																
1	Misa - Killing (Byrnihat) I	220	Misa (PG)													
			Killing (Byrnihat)	Yes, ABB make REL670, Numerical	Yes, Areva make P442, Numerical	Yes	Yes	Yes, REL670 & P442 Relay	Yes, REL670 & P442 Relay	Yes, REL670 & P442 Relay	Yes	1	1	Yes, REL670 & P442 Relay	Yes, REL670 & P442 Relay	Yes, REL670 & P442 Relay
2	Misa - Killing (Byrnihat) II	220	Misa (PG)													
			Killing (Byrnihat)	Yes, ABB make REL670, Numerical	Yes, Areva make P442, Numerical	Yes	Yes	Yes, REL670 & P442 Relay	Yes, REL670 & P442 Relay	Yes, REL670 & P442 Relay	Yes	1	1	Yes, REL670 & P442 Relay	Yes, REL670 & P442 Relay	Yes, REL670 & P442 Relay
4. Owner of End: POWERGRID & NEEPCO																
1	220 kV AGBPP - Mariani(PG)	220	AGBPP	Yes	Yes	Yes	Yes	Yes	Yes	Yes	Yes	1	2	Yes	Yes	Yes
			Mariani (PG)	Yes, MICOM P444	Yes, REL 670		Yes	Yes	Yes	Yes	Yes	Yes			Yes	Yes
5. Owner of End: DoP, Arunachal Pradesh & NEEPCO																
1	220 kV AGBPP - Deomali	220	AGBPP	EPAC 3000 ALSTOM	SHPM 101 ALSTOM	No	No	No	No	Yes	Yes	1	2	Yes	Yes	Yes
			Deomali													
6. Owner of End: POWERGRID & NEEPCO																
1	Misa - Kopili I	220	Misa (PG)	Yes, SIMENS 7SA522	Yes, MICOM P442			Yes	Yes		Yes			Yes	Yes	
			Kopili													
2	Misa - Kopili II	220	Misa (PG)	Yes, SIMENS 7SA522	Yes, MICOM P442			Yes	Yes		Yes			Yes	Yes	
			Kopili													
3	Misa - Kopili III	220	Misa (PG)	Yes, 7SA513	Yes, MICOM P442			Yes	Yes		Yes			Yes	Yes	
			Kopili													
Note 1) Main-I Protection indicates Distance Protection 2) Main-II Protection indicates one of Distance Protection / Directional Comparison Protection / Phase Segregated Line Differential protection 3) Type of Relay indicates it's operational mechanism - Numerical / Static / Electro-mechanical 4) List of inbuilt features of Numerical Relays are also to be furnished alongwith this format																

400 kV Transmission Line Protection Details																	Annexure II		
Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details										Data Recording System Details					
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Main II Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) type Earth Fault Relay exists (Yes/No)	Two stage Over-Voltage Protection exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes/No)	Carrier aided Inter-tripping exists (Yes/No)	Power Swing Blocking Feature exists (Yes/No)	Pole Discrepancy Relay exists (Yes / No)	Number of Core used for CT & VT, used for Main I	Number of Core used for CT & VT, used for Main II	Disturbance Recorder exists (Yes/No)	Event Logger / Sequential Event Recorder exists (Yes/No)	Fault Locator exists (Yes/No)			
1. Owner of Line : NETC																			
1	Silchar - Azara	400	Azara	Yes (REL670 ABB)	Yes (REL670 ABB)	Yes	Yes	Yes	Yes	Yes	Yes	1	1	Yes	Yes	Yes			
			Silchar (PG)	Yes, MICOM P444	Yes, REL670		Yes	Yes	Yes		Yes		Yes	Yes					
2	Silchar - Killing (Byrnihat)	400	Silchar (PG)	Yes, MICOM P444	Yes, REL670		Yes	Yes	Yes		Yes			Yes	Yes				
			Killing (Byrnihat)																
3	Palatana- Silchar I	400	Palatana																
			Silchar (PG)	Yes, MICOM P444	Yes, REL670		Yes	Yes	Yes		Yes		Yes	Yes					
4	Palatana- Silchar II	400	Palatana																
			Silchar (PG)	Yes, MICOM P444	Yes, REL670		Yes	Yes	Yes		Yes		Yes	Yes					
5	Killing- Bongaigaon	400	Killing (Byrnihat)																
			Bongaigaon (PG)	Yes, MICOM P444	Yes, REL670		Yes	Yes	Yes		Yes		Yes	Yes					
6	Azara- Bongaigaon	400	Azara																
			Bongaigaon (PG)	Yes, MICOM P444	Yes, REL670		Yes	Yes	Yes		Yes		Yes	Yes					

400 kV Transmission Line Protection Details															Annexure II		
Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details										Data Recording System Details			
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Main II Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) type Earth Fault Relay exists (Yes/No)	Two stage Over-Voltage Protection exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes/No)	Carrier aided Inter-tripping exists (Yes/No)	Power Swing Blocking Feature exists (Yes/No)	Pole Discrepancy Relay exists (Yes / No)	Number of Core used for CT & VT, used for Main I	Number of Core used for CT & VT, used for Main II	Disturbance Recorder exists (Yes/No)	Event Logger / Sequential Event Recorder exists (Yes/No)	Fault Locator exists (Yes/No)	
2. Owner of Line : POWERGRID																	
1	Bongaigaon- Binaguri I	400	Bongaigaon (PG)	Yes, MICOM P442	Yes, SIEMENS 7SA522		Yes	Yes	Yes		Yes			Yes	Yes		
			Binaguri (PG)														
2	Bongaigaon- Binaguri II	400	Bongaigaon (PG)	Yes, MICOM P442	Yes, SIEMENS 7SA522		Yes	Yes	Yes		Yes			Yes	Yes		
			Binaguri (PG)														
3	Bongaigaon- Binaguri III	400	Bongaigaon (PG)	Yes, MICOM P444	Yes, REL670		Yes	Yes	Yes		Yes			Yes	Yes		
			Binaguri (PG)														
4	Bongaigaon- Binaguri IV	400	Bongaigaon (PG)	Yes, MICOM P444	Yes, REL670		Yes	Yes	Yes		Yes			Yes	Yes		
			Binaguri (PG)														
5	Bongaigaon- Balipara I	400	Bongaigaon (PG)	Yes, MICOM P444	Yes, 7SA513		Yes	Yes	Yes		Yes			Yes	Yes		
			Balipara (PG)	Yes, MICOM P442	Yes, SIEMENS 7SA522		Yes	Yes	Yes		Yes				Yes	Yes	
6	Bongaigaon- Balipara II	400	Bongaigaon (PG)	Yes, MICOM P444	Yes, 7SA513		Yes	Yes	Yes		Yes			Yes	Yes		
			Balipara (PG)	Yes, MICOM P442	Yes, SIEMENS 7SA522		Yes	Yes	Yes		Yes				Yes	Yes	

400 kV Transmission Line Protection Details														Annexure II		
Sl. No.	Name of Line	Charged Voltage in kV	End specified for Protection	Protection Details										Data Recording System Details		
				Main I Protection exists (Type of Relay and Make) (Yes/No)	Main II Protection exists (Type of Relay and Make) (Yes/No)	Directional Instantaneous Definite Minimum Time(IDMT) type Earth Fault Relay exists (Yes/No)	Two stage Over-Voltage Protection exists (Yes/No)	Auto Reclosing (Single Phase / Three Phase) exists (Yes/No)	Carrier aided Inter-tripping exists (Yes/No)	Power Swing Blocking Feature exists (Yes/No)	Pole Discrepancy Relay exists (Yes / No)	Number of Core used for CT & VT, used for Main I	Number of Core used for CT & VT, used for Main II	Disturbance Recorder exists (Yes/No)	Event Logger / Sequential Event Recorder exists (Yes/No)	Fault Locator exists (Yes/No)
7	Bongaigaon- Balipara III	400	Bongaigaon (PG)	Yes, MICOM P444	Yes, REL670		Yes	Yes	Yes		Yes			Yes	Yes	
			Balipara (PG)	Yes, MICOM P442	Yes, REL670		Yes	Yes	Yes		Yes				Yes	Yes
8	Bongaigaon- Balipara IV	400	Bongaigaon (PG)	Yes, MICOM P444	Yes, REL670		Yes	Yes	Yes		Yes			Yes	Yes	
			Balipara (PG)	Yes, MICOM P442	Yes, REL670		Yes	Yes	Yes		Yes				Yes	Yes
9	Balipara- Ranganadi I	400	Balipara (PG)	Yes, MICOM P444	Yes, REL670		Yes	Yes	Yes		Yes			Yes	Yes	
			Ranganadi	Yes, MICOM P442, ALSTOM	Yes, PD571, ALSTOM	No	Yes	Yes (Single Phase)	Yes	Yes	Yes	1	1 & 2	No	No	No
10	Balipara- Ranganadi II	400	Balipara (PG)	Yes, MICOM P444	Yes, REL670		Yes	Yes	Yes		Yes			Yes	Yes	
			Ranganadi	Yes, MICOM P442, ALSTOM	Yes, PD571, ALSTOM	No	Yes	Yes (Single Phase)	Yes	Yes	Yes	1	1 & 2	No	No	No
11	Balipara- Misa I	400	Balipara (PG)	Yes, MICOM P444	Yes, REL670		Yes	Yes	Yes		Yes			Yes	Yes	
			Misa (PG)	Yes, SIEMENS 7SA522	Yes, MICOM P442		Yes	Yes	Yes	Yes	Yes				Yes	Yes
12	Balipara- Misa II	400	Balipara (PG)	Yes, MICOM P444	Yes, REL670		Yes	Yes	Yes		Yes			Yes	Yes	
			Misa (PG)	Yes, SIEMENS 7SA522	Yes, MICOM P442		Yes	Yes	Yes	Yes	Yes				Yes	Yes

Note 1) Main-I Protection indicates Distance Protection
2) Main-II Protection indicates one of Distance Protection / Directional Comparison Protection / Phase Segregated Line Differential protection
3) Type of Relay indicates it's operational mechanism - Numerical / Static / Electro-mechanical
4) List of inbuilt features of Numerical Relays are also to be furnished alongwith this

Transformer Protection Details

Annexure II

Sl. No.	Name of Transformer	LV side/ HV side	Differential Protection exists (Yes/No)	Over Fluxing Protection exists (Yes/No)	REF Protection exists (Yes/No)	Directional Over Current Protection exists (Yes/No)	Impedance Protection exists (Yes/No)	Buchholz Operation exists (Yes/No)	WTI Protection exists (Yes/No)	OTI Protection exists (Yes/No)	MOG with low oil level alarm exists (Yes/No)	OSR for OLTC exists (Yes/No)	PRD exists (Yes/No)	SA exists (Yes/No)	Tertiary Winding Protection exists (Yes/No)	Overload Alarm exists (Yes/No)	
3. Owner of Transformer : Meghalaya, MePTCL																	
1	400/220 kV Killing(Byrnihat) 1x315 MVA Transformer I	LV side															
		HV side															
	400/220 kV Killing(Byrnihat) 1x315 MVA Transformer II	LV side															
		HV side															
	220/132 kV Killing(Byrnihat) 1x160 MVA Transformer I	LV side	Yes, ABB make, RET670, Numerical	Yes	Yes	Non directional REX ABB make	No	Yes	Yes	Yes	Yes	Yes	Yes	Yes	Yes	No	Yes
		HV side													Yes		
		220/132 kV Killing(Byrnihat) 1x160 MVA Transformer II	LV side	Yes, ABB make, RET670, Numerical	Yes	Yes	Non directional REX ABB make	No	Yes	Yes	Yes	Yes	Yes	Yes	Yes	No	Yes
			HV side												Yes		
2	132/33 kV Cherrapunjee (Sohra) 1x12.5 MVA Transformer	LV side	No	No	No	Non directional CDG, EE make	No	Yes	Yes	Yes	No	No	Yes	Yes	No	Yes	
		HV side				Non directional CDG, EE make								No			Yes
3	132/33 kV EPIP I 1x20 MVA Transformer I	LV side	Yes, ABB make, RET670, Numerical	Yes	No	Non directional P122 Areva make	No	Yes	Yes	Yes	Yes	Yes	Yes	Yes	No	Yes	
		HV side				Non directional P122 Areva make								No			Yes
	132/33 kV EPIP I 1x20 MVA Transformer II	LV side	Yes, ABB make, RET670, Numerical	Yes	No	Non directional P122 Areva make	No	Yes	Yes	Yes	No	No	Yes	Yes	No	Yes	
		HV side				Non directional P122 Areva make								No			Yes
4	132/33 kV EPIP II 1x50 MVA Transformer	LV side	Yes, Toshiba make, GRT100, Numerical	No	No	Non directional P122 Areva make	No	Yes	Yes	Yes	Yes	Yes	Yes	Yes	No	Yes	
		HV side				Non directional P122 Areva make								No			Yes
	132/33 kV EPIP II 1x20 MVA Transformer	LV side	Yes, ABB make, RET670, Numerical	Yes	No	Non directional P122 Areva make	No	Yes	Yes	Yes	Yes	Yes	Yes	Yes	No	Yes	
		HV side				Non directional P122 Areva make								No			Yes
5	132/33 kV Khliehriat 1x20 MVA Transformer I	LV side	Yes, ABB make, RET670, Numerical	Yes	No	Non directional P122 Areva make	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No	Yes	
		HV side				Non directional CDG, EE make								No			Yes
	132/33 kV Khliehriat 1x20 MVA Transformer II	LV side	Yes, ABB make, RET670, Numerical	Yes	No	Non directional P122 Areva make	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No	Yes	
		HV side				Non directional P122 Areva make								No			Yes

Transformer Protection Details

Annexure II

Sl. No.	Name of Transformer	LV side/ HV side	Differential Protection exits (Yes/No)	Over Fluxing Protection exits (Yes/No)	REF Protection exists (Yes/No)	Directional Over Current Protection exits (Yes/No)	Impedance Protection exists (Yes/No)	Buchholz Operation exits (Yes/No)	WTI Protection exists (Yes/No)	OTI Protection exists (Yes/No)	MOG with low oil level alarm exists (Yes/No)	OSR for OLTC exists (Yes/No)	PRD exists (Yes/No)	SA exists (Yes/No)	Tertiary Winding Protection exists (Yes/No)	Overload Alarm exists (Yes/No)	
6	132/33/11 kV Lumshnong 1x10 MVA Transformer	LV side 11 kV	No	No	No	Non directional CDG, EE make	No	Yes	Yes	Yes	No	No	Yes	Yes	Yes	Yes	
		LV side 33 kV				Non directional JRC 059,JVS make	No		Yes					Yes			Yes
		HV side				Non directional P122 Areva make	No		Yes					Yes			Yes
7	132/33 kV Mawlai 1x20 MVA Transformer I	LV side	Yes, Areva make, P632, Numerical	Yes	No	Non directional P122 Areva make	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No	Yes	
		HV side				Non directional P122 Areva make	No		Yes					Yes			Yes
	132/33 kV Mawlai 1x20 MVA Transformer II	LV side	Yes, Areva make, P632, Numerical	Yes	No	Non directional P122 Areva make	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No	Yes	
		HV side				Non directional P122 Areva make	No		Yes					Yes			Yes
	132/33 kV Mawlai 1x20 MVA Transformer III	LV side	Yes, Areva make, P632, Numerical	Yes	No	Non directional P122 Areva make	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No	Yes	
		HV side				Non directional P122 Areva make	No		Yes					Yes			Yes
8	132/33 kV Nangalbibra 1x12.5 MVA Transformer I	LV side	Yes, EE make, Static type	No	No	Non directional P122 Areva make	No	Yes	Yes	Yes	No	No	Yes	Yes	No	Yes	
		HV side				Non directional P122 Areva make	No		Yes					Yes			Yes
	132/33 kV Nangalbibra 1x12.5 MVA Transformer II	LV side	Yes, Areva make, P632, Numerical	Yes	No	Non directional P122 Areva make	No	Yes	Yes	Yes	No	No	Yes	Yes	No	Yes	
		HV side				Non directional P122 Areva make	No		Yes					Yes			Yes
9	132/33 kV NEHU 1x20 MVA Transformer I	LV side	Yes, ABB make, RET670, Numerical	Yes	No	Non directional P122 Areva make	No	Yes	Yes	Yes	Yes	Yes	Yes	Yes	No	Yes	
		HV side				Non directional P122 Areva make	No		Yes					Yes			Yes
	132/33 kV NEHU 1x20 MVA Transformer II	LV side	Yes, EE make, Static type	Yes	No	Non directional P122 Areva make	No	Yes	Yes	Yes	Yes	Yes	Yes	Yes	No	Yes	
		HV side				Non directional CDG, EE make	No		Yes					Yes			Yes
10	132/33 kV Nongstoin 1x12.5 MVA Transformer	LV side	Yes, Areva make, P632, Numerical	Yes	Yes	Non directional P122 Areva make	No	Yes	Yes	Yes	Yes	Yes	Yes	Yes	No	Yes	
		HV side				Non directional P122 Areva make	No		Yes					Yes			Yes

Transformer Protection Details

Annexure II

Sl. No.	Name of Transformer	LV side/ HV side	Differential Protection exits (Yes/No)	Over Fluxing Protection exits (Yes/No)	REF Protection exits (Yes/No)	Directional Over Current Protection exits (Yes/No)	Impedance Protection exits (Yes/No)	Buchholz Operation exits (Yes/No)	WTI Protection exits (Yes/No)	OTI Protection exits (Yes/No)	MOG with low oil level alarm exists (Yes/No)	OSR for OLTC exists (Yes/No)	PRD exists (Yes/No)	SA exists (Yes/No)	Tertiary Winding Protection exists (Yes/No)	Overload Alarm exists (Yes/No)
11	132/33 kV Rongkhon (Tura) 1x20 MVA Transformer I	LV side	Yes, Areva make, P632, Numerical	Yes	No	Non directional P122 Areva make	No	Yes	Yes	Yes	Yes	Yes	Yes	Yes	No	Yes
		HV side				Non directional P122 Areva make	No		Yes							
	132/33 kV Rongkhon (Tura) 1x20 MVA Transformer II	LV side	Yes, Areva make, P632, Numerical	Yes	No	Non directional P122 Areva make	No	Yes	Yes	Yes	Yes	Yes	Yes	Yes	No	Yes
		HV side				Non directional P122 Areva make	No		Yes							
	132/33 kV Rongkhon (Tura) 1x5 MVA Transformer I	LV side	Yes, EE make, Static type	Yes	No	Non directional P122 Areva make	No	Yes	Yes	Yes	Yes	Yes	Yes	Yes	No	Yes
		HV side				Non directional P122 Areva make	No		Yes							
	132/33 kV Rongkhon (Tura) 1x5 MVA Transformer II	LV side	Yes, EE make, Static type	Yes	No	Non directional P122 Areva make	No	Yes	Yes	Yes	Yes	Yes	Yes	Yes	No	Yes
		HV side				Non directional P122 Areva make	No		Yes							
	132/33 kV Rongkhon (Tura) 1x5 MVA Transformer III	LV side	Yes, EE make, Static type	Yes	No	Non directional CDG, EE make	No	Yes	Yes	Yes	Np	No	Yes	Yes	No	Yes
		HV side				Non directional, CDG EE make	No		Yes							
12	132/33 kV Umiam 1x20 MVA Transformer I	LV side	Yes, Toshiba make, GRT100, Numerical	Yes	No	Non directional JNC066, JVS make	No	Yes	Yes	Yes	Yes	Yes	Yes	Yes	No	Yes
		HV side				Non directional JNC066, JVS make	No		Yes							
	132/33 kV Umiam 1x20 MVA Transformer II	LV side	Yes, Areva make, P632, Numerical	Yes	No	Non directional P141 Areva make	No	Yes	Yes	Yes	Yes	Yes	Yes	Yes	No	Yes
		HV side				Non directional P122 Areva make	No		Yes							
13	132/33/11 kV NEIGRIHMS 1x10 MVA Transformer I	LV side	Yes, Areva make, P632, Numerical	Yes	No	Non directional P122 Areva make	No	Yes	Yes	Yes	Yes	Yes	Yes	Yes	No	Yes
		HV side				Non directional P122 Areva make	No		Yes							
	132/33/11 kV NEIGRIHMS 1x10 MVA Transformer II	LV side	Yes, Areva make, P632, Numerical	Yes	No	Non directional P122 Areva make	No	Yes	Yes	Yes	Yes	Yes	Yes	Yes	No	Yes
		HV side				Non directional P122 Areva make	No		Yes							

Transformer Protection Details

Annexure II

Sl. No.	Name of Transformer	LV side/ HV side	Differential Protection exits (Yes/No)	Over Fluxing Protection exits (Yes/No)	REF Protection exists (Yes/No)	Directional Over Current Protection exits (Yes/No)	Impedance Protection exists (Yes/No)	Buchholz Operation exits (Yes/No)	WTI Protection exists (Yes/No)	OTI Protection exists (Yes/No)	MOG with low oil level alarm exists (Yes/No)	OSR for OLTC exists (Yes/No)	PRD exists (Yes/No)	SA exists (Yes/No)	Tertiary Winding Protection exists (Yes/No)	Overload Alarm exists (Yes/No)
14	132/33 kV Mawngap 1x20 MVA Transformer I	LV side	Yes, Areva make, P632, Numerical	Yes	No	Yes, Directional P141, Areva make	No	Yes	Yes	Yes	Yes	Yes	Yes	Yes	No	Yes
		HV side				Yes, Directional P141, Areva make	No		Yes							
	132/33 kV Mawngap 1x20 MVA Transformer II	LV side	Yes, Areva make, P632, Numerical	Yes	No	Yes, Directional P141, Areva make	No	Yes	Yes	Yes	Yes	Yes	Yes	Yes	No	Yes
		HV side				Yes, Directional P141, Areva make	No		Yes							
15	132/33 kV Umiam Stg I 1x10.6 MVA Transformer I	LV side	Yes, Areva make, P632, Numerical	Yes	No	Yes, Directional P141, Areva make	No	Yes	Yes	Yes	Yes	Yes	Yes	Yes	No	Yes
		HV side				Yes, Directional P141, Areva make	No		Yes							
	132/33 kV Umiam Stg I 1x10.6 MVA Transformer II	LV side	Yes, Areva make, P632, Numerical	Yes	No	Yes, Directional P141, Areva make	No	Yes	Yes	Yes	Yes	Yes	Yes	Yes	No	Yes
		HV side				Yes, Directional P141, Areva make	No		Yes							
	132/33 kV Umiam Stg I 1x10.6 MVA Transformer III	LV side	Yes, Areva make, P632, Numerical	Yes	No	Yes, Directional P141, Areva make	No	Yes	Yes	Yes	Yes	Yes	Yes	Yes	No	Yes
		HV side				Yes, Directional P141, Areva make	No		Yes							
	132/33 kV Umiam Stg I 1x10.6 MVA Transformer IV	LV side	Yes, Areva make, P632, Numerical	Yes	No	Yes, Directional P141, Areva make	No	Yes	Yes	Yes	Yes	Yes	Yes	Yes	No	Yes
		HV side				Yes, Directional P141, Areva make	No		Yes							
16	132/33 kV Umiam Stg II 1x10.5 MVA Transformer I	LV side	Digital M-3311, Beckwith Electric Co.	Yes	No	Beckwith Electric Co.	No	Yes	Yes	Yes	Yes	Yes	Yes	Yes	No	Yes
		HV side				Beckwith Electric Co.	No		Yes							
	132/33 kV Umiam Stg II 1x10.5 MVA Transformer II	LV side	Digital M-3311, Beckwith Electric Co.	Yes	No	Beckwith Electric Co.	No	Yes	Yes	Yes	Yes	Yes	Yes	Yes	No	Yes
		HV side				Beckwith Electric Co.	No		Yes							
17	132/33 kV Umiam Stg III 1x37.5 MVA Transformer I	LV side	Yes, ABB make, RET670, Numerical	Yes	Yes	Non directional CDG, EE make	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No	Yes
		HV side				Non directional CDG, EE make	No		Yes							
	132/33 kV Umiam Stg III 1x37.5 MVA Transformer II	LV side	Yes, ABB make, RET670, Numerical	Yes	Yes	Non directional CDG, EE make	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No	Yes
		HV side				Non directional CDG, EE make	No		Yes							

Transformer Protection Details

Annexure II

Sl. No.	Name of Transformer	LV side/ HV side	Differential Protection exists (Yes/No)	Over Fluxing Protection exists (Yes/No)	REF Protection exists (Yes/No)	Directional Over Current Protection exists (Yes/No)	Impedance Protection exists (Yes/No)	Buchholz Operation exists (Yes/No)	WTI Protection exists (Yes/No)	OTI Protection exists (Yes/No)	MOG with low oil level alarm exists (Yes/No)	OSR for OLTC exists (Yes/No)	PRD exists (Yes/No)	SA exists (Yes/No)	Tertiary Winding Protection exists (Yes/No)	Overload Alarm exists (Yes/No)	
2	132/66 kV Kolasib (Bawktlang) 12.5 MVA	LV side	No	No	No	No	No	Yes	Yes	Yes	No	No	No	Yes	No	No	
		HV side	No	No	No	No	No	Yes	Yes	Yes	No	No	No	Yes	No	No	
	132/33 kV Kolasib (Bawktlang) 12.5 MVA	LV side	No	No	No	No	No	Yes	Yes	Yes	Yes	No	No	Yes	No	No	
		HV side	No	No	No	No	No	Yes	Yes	Yes	Yes	No	No	Yes	No	No	
	66/33 kV Kolasib (Bawktlang) 6.3 MVA	LV side	No	No	No	No	No	Yes	Yes	Yes	Yes	No	No	Yes	Yes	No	No
		HV side	No	No	No	No	No	Yes	Yes	Yes	Yes	No	No	Yes	Yes	No	No
3	132/33 kV Serchip (Bukpui) 12.5 MVA Transformer I	LV side	No	No	No	No	No	Yes	Yes	Yes	No	No	Yes	Yes	No	No	
		HV side	No	No	No	No	No	Yes	Yes	Yes	No	No	Yes	Yes	No	No	
	132/33 kV Serchip (Bukpui) 6.3 MVA Transformer II	LV side	No	No	No	No	No	Yes	Yes	Yes	Yes	No	No	Yes	No	No	
		HV side	No	No	No	No	No	Yes	Yes	Yes	Yes	No	No	Yes	No	No	
4	132/33 kV Lunglei (Khawiva) 12.5 MVA Transformers I	LV side	No	No	No	No	No	Yes	Yes	Yes	No	No	Yes	Yes	No	No	
		HV side	No	No	No	No	No	Yes	Yes	Yes	No	No	Yes	Yes	No	No	
	132/33 kV Lunglei (Khawiva) 12.5 MVA Transformers II	LV side	No	No	No	No	No	Yes	Yes	Yes	No	No	Yes	Yes	No	No	
		HV side	No	No	No	No	No	Yes	Yes	Yes	No	No	Yes	Yes	No	No	
5	132/33 kV Khawzawl 12.5 MVA Transformers I	LV side	No	No	No	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No	No	
		HV side	No	No	No	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No	No	
6	132/33 kV Luangmual, 12.5 MVA Transformers I	LV side	No	No	No	No	No	Yes	Yes	Yes	No	No	Yes	Yes	No	No	
		HV side	No	No	No	No	No	Yes	Yes	Yes	No	No	Yes	Yes	No	No	
	132/33 kV Luangmual, 12.5 MVA Transformers II	LV side	No	No	No	No	No	Yes	Yes	Yes	No	No	Yes	Yes	No	No	
		HV side	No	No	No	No	No	Yes	Yes	Yes	No	No	Yes	Yes	No	No	
7	132/33 kV Saitual 1x6.3 MVA Transformer	LV side	No	No	No	No	No	Yes	Yes	Yes	No	No	No	Yes	No	No	
		HV side	No	No	No	No	No	Yes	Yes	Yes	No	No	No	Yes	No	No	
8	132/33 kV Zemabawk (Zuangtui) 12.5 MVA	LV side	No	No	No	No	No	Yes	Yes	Yes	No	No	Yes	Yes	No	No	
		HV side	No	No	No	No	No	Yes	Yes	Yes	No	No	Yes	Yes	No	No	
	132/33 kV Zemabawk (Zuangtui) 12.5 MVA	LV side	No	No	No	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No	No	
		HV side	No	No	No	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No	No	
5. Owner of Transformer : NEEPCO																	
1	53 MVA, 11 kV/132 kV Generator Transformer at Ranganadi	LV side	Yes	Yes	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No	No	
		HV side		No													
2	400 kV/132 kV, 120 MVA ICT-I at Ranganadi	LV side	Yes	Yes	Yes	No	No	Yes	Yes	Yes	Yes	Yes	Yes	Yes	Yes (Neutral Displacement Protection)	No	
		HV side		No													
3	400 kV/132 kV, 120 MVA ICT-II at Ranganadi	LV side	Yes	Yes	Yes	No	No	Yes	Yes	Yes	Yes	Yes	Yes	Yes	Yes (Neutral Displacement Protection)	No	
		HV side		No													
4	11/220 kV, 50 MVA Generator Transformer 1 at AGBPP	LV side	Yes	Yes	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes				
		HV side	Yes	No	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes				
5	11/220 kV, 50 MVA Generator Transformer 2 at	LV side	Yes	Yes	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes				

Transformer Protection Details

Annexure II

Sl. No.	Name of Transformer	LV side/ HV side	Differential Protection exists (Yes/No)	Over Fluxing Protection exists (Yes/No)	REF Protection exists (Yes/No)	Directional Over Current Protection exists (Yes/No)	Impedance Protection exists (Yes/No)	Buchholz Operation exists (Yes/No)	WTI Protection exists (Yes/No)	OTI Protection exists (Yes/No)	MOG with low oil level alarm exists (Yes/No)	OSR for OLTC exists (Yes/No)	PRD exists (Yes/No)	SA exists (Yes/No)	Tertiary Winding Protection exists (Yes/No)	Overload Alarm exists (Yes/No)
5	Generator Transformer 2 at AGBPP	HV side	Yes	No	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes			
6	11/220 kV, 50 MVA Generator Transformer 3 at AGBPP	LV side	Yes	Yes	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes			
		HV side	Yes	No	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes			
7	11/220 kV, 50 MVA Generator Transformer 4 at AGBPP	LV side	Yes	Yes	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes			
		HV side	Yes	No	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes			
8	11/220 kV, 50 MVA Generator Transformer 5 at AGBPP	LV side	Yes	Yes	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes			
		HV side	Yes	No	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes			
9	11/220 kV, 50 MVA Generator Transformer 6 at AGBPP	LV side	Yes	Yes	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes			
		HV side	Yes	No	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes			
10	11/220 kV, 50 MVA Generator Transformer 7 at AGBPP	LV side	Yes	Yes	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes			
		HV side	Yes	No	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes			
11	11/220 kV, 50 MVA Generator Transformer 8 at AGBPP	LV side	Yes	Yes	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes			
		HV side	Yes	No	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes			
12	11/220 kV, 50 MVA Generator Transformer 9 at AGBPP	LV side	Yes	Yes	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes			
		HV side	Yes	No	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes			
13	11/132 kV, 3x12.5(37.5) MVA Generator Transformer 1 at AGTPP	LV side	Yes	Yes	Yes	No	Yes	Yes	Yes	Yes	Yes	No	Yes	Yes	No	No
		HV side	Yes	No	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No	No
14	11/132 kV, 3x12.5(37.5) MVA Generator Transformer 2 at AGTPP	LV side	Yes	Yes	Yes	No	Yes	Yes	Yes	Yes	Yes	No	Yes	Yes	No	No
		HV side	Yes	No	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No	No
15	11/132 kV, 3x12.5(37.5) MVA Generator Transformer 3 at AGTPP	LV side	Yes	Yes	Yes	No	Yes	Yes	Yes	Yes	Yes	No	Yes	Yes	No	No
		HV side	Yes	No	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No	No
16	11/132 kV, 3x12.5(37.5) MVA Generator Transformer 4 at AGTPP	LV side	Yes	Yes	Yes	No	Yes	Yes	Yes	Yes	Yes	No	Yes	Yes	No	No
		HV side	Yes	No	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No	No
6. Owner of Transformer : NHPC																
1	11/132 kV, Generator Transformer at Loktak	LV side	Yes	Yes	Yes	No	No	Yes	Yes	Yes	No	No	No	Yes	No	Yes
		HV side														

Transformer Protection Details

Annexure II

Sl. No.	Name of Transformer	LV side/ HV side	Differential Protection exits (Yes/No)	Over Fluxing Protection exits (Yes/No)	REF Protection exits (Yes/No)	Directional Over Current Protection exits (Yes/No)	Impedance Protection exits (Yes/No)	Buchholz Operation exits (Yes/No)	WTI Protection exits (Yes/No)	OTI Protection exits (Yes/No)	MOG with low oil level alarm exists (Yes/No)	OSR for OLTC exists (Yes/No)	PRD exists (Yes/No)	SA exists (Yes/No)	Tertiary Winding Protection exists (Yes/No)	Overload Alarm exists (Yes/No)
---------	---------------------	---------------------	--	--	-------------------------------	--	-------------------------------------	-----------------------------------	-------------------------------	-------------------------------	--	------------------------------	---------------------	--------------------	---	--------------------------------

8. Owner of Transformer : TSECL

1	Budhjungnagar	25 MVA	LV side	Yes	No	Yes	No	No	No	No	No	No	No	No	Yes	No
		132/33 KV	HV side	Yes	No	No	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No
2	Jirania	25 MVA	LV side	Yes	No	Yes	No	No	No	No	No	No	No	No	Yes	No
		132/33 KV	HV side	Yes	No	No	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No
		15 MVA	LV side	Yes	No	Yes	No	No	No	No	No	No	No	No	Yes	No
		132/11 KV	HV side	Yes	No	No	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No
3	Gamaitila	15 MVA	LV side	Yes	No	Yes	No	No	No	No	No	No	No	No	Yes	No
		132/11 KV	HV side	Yes	No	No	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No
4	Ambassa	25 MVA	LV side	Yes	No	No	No	No	No	No	No	No	No	No	Yes	No
		132/33 KV	HV side	Yes	No	No	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No
		7.5/2.5/5 MVA	LV side	Yes	No	No	No	No	No	No	No	No	No	No	Yes	Yes at tertiary
5	P K Bari		HV side	Yes	No	No	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No
		15 MVA	LV side	Yes	No	No	No	No	No	No	No	No	No	No	Yes	No
		132/33 KV	HV side	Yes	No	No	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No
		15 MVA	LV side	Yes	No	No	No	No	No	No	No	No	No	No	Yes	No
6	Kailashahar	132/11 KV	HV side	Yes	No	No	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No
		15 MVA	LV side	Yes	No	No	No	No	No	No	No	No	No	No	Yes	No
		132/33 KV	HV side	Yes	No	No	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No
		7.5/2.5/5 MVA	LV side	Yes	No	No	No	No	No	No	No	No	No	No	Yes	Yes at tertiary
		7.5/2.5/5 MVA	HV side	Yes	No	No	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	Yes at tertiary
		7.5/2.5/5 MVA	LV side	Yes	No	No	No	No	No	No	No	No	No	No	Yes	Yes at tertiary
7	Missiontilla		HV side	Yes	No	No	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	Yes at tertiary
		7.5/2.5/5 MVA	LV side	Yes	No	No	No	No	No	No	No	No	No	No	Yes	Yes at tertiary
		7.5/2.5/5 MVA	HV side	Yes	No	No	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	Yes at tertiary
		7.5/2.5/5 MVA	LV side	Yes	No	No	No	No	No	No	No	No	No	No	Yes	Yes at tertiary
		7.5/2.5/5 MVA	HV side	Yes	No	No	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	Yes at tertiary
		25 MVA	LV side	Yes	No	No	No	No	No	No	No	No	No	No	Yes	No
		132/33 KV	HV side	Yes	No	No	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No
		10 MVA	LV side	Yes	No	No	No	No	No	No	No	No	No	No	Yes	No
8	Kamalpur	132/11 KV	HV side	Yes	No	No	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No
		10 MVA	LV side	Yes	No	No	No	No	No	No	No	No	No	No	Yes	No
		132/11 KV	HV side	Yes	No	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No
		10 MVA	LV side	Yes	No	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No
9	Dhalabil	15 MVA	LV side	Yes	No	No	No	No	No	No	No	No	No	No	Yes	No
		132/11 KV	HV side	Yes	No	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No
		7.5 MVA	LV side	Yes	No	No	No	No	No	No	No	No	No	No	Yes	No
		132/33 KV	HV side	Yes	No	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No

Transformer Protection Details

Annexure II

Sl. No.	Name of Transformer	LV side/ HV side	Differential Protection exits (Yes/No)	Over Fluxing Protection exits (Yes/No)	REF Protection exists (Yes/No)	Directional Over Current Protection exits (Yes/No)	Impedance Protection exists (Yes/No)	Buchholz Operation exits (Yes/No)	WTI Protection exists (Yes/No)	OTI Protection exists (Yes/No)	MOG with low oil level alarm exists (Yes/No)	OSR for OLTC exists (Yes/No)	PRD exists (Yes/No)	SA exists (Yes/No)	Tertiary Winding Protection exists (Yes/No)	Overload Alarm exists (Yes/No)	
10	Udaipur	15 MVA	LV side	Yes	No	No	No	No	No	No	No	No	No	No	Yes	No	
		132/11 KV	HV side	Yes	No	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No	
		15 MVA	LV side	Yes	No	No	No	No	No	No	No	No	No	No	No	Yes	No
		132/11 KV	HV side	Yes	No	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No	
11	Surjyamaninagar	50 MVA	LV side	Yes	No	Yes	No	No	No	No	No	No	No	No	Yes	No	
		132/33 KV	HV side	Yes	No	No	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No	
		50 MVA	LV side	Yes	No	Yes	No	No	No	No	No	No	No	No	No	Yes	No
		132/33 KV	HV side	Yes	No	No	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No	
12	Grid, 79 Tilla	25 MVA	LV side	Yes	No	No	No	No	No	No	No	No	No	No	Yes	No	
		132/33 KV	HV side	Yes	No	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No	
		15 MVA	LV side	Yes	No	No	No	No	No	No	No	No	No	No	No	Yes	No
		132/11 KV	HV side	Yes	No	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No	
		15 MVA	LV side	Yes	No	No	No	No	No	No	No	No	No	No	No	Yes	No
		132/33 KV	HV side	Yes	No	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No	
		15 MVA	LV side	Yes	No	No	No	No	No	No	No	No	No	No	No	Yes	No
		132/33 KV	HV side	Yes	No	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No	
		15 MVA	LV side	Yes	No	No	No	No	No	No	No	No	No	No	No	Yes	No
		132/33 KV	HV side	Yes	No	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No	
		25 MVA	LV side	Yes	No	No	No	No	No	No	No	No	No	No	Yes	No	
		132/33 KV	HV side	Yes	No	Yes	No	No	Yes	Yes	Yes	Yes	No	Yes	Yes	No	

Note : 1. REF : Restricted Earth Fault, 2. WTI : Winding Temperature Indicator., 3. OTI : Oil Temperature Indicator)

4. MOG : Magnetic Oil Gauge, 5. OSR : Oil Surge Relay, 6. OLTC : On Load Tap Changer

7. PRD : Pressure Relieve Device, 8. SA : Surge Arrestor 9. List of inbuilt features of Numerical Relays are also to be furnished alongwith this format

Reactor Protection Details										Annexure II
Sl. No.	Name of Line Reactor/ Bus Reactor/ Tertiary Reactor	Differential Protection exists (Yes/No)	REF Protection exists (Yes/No)	Definite Time Over Current Protection exists (Yes/No)	Earth Fault Protection exists (Yes/No)	Buchholz Operation exists (Yes/No)	WTI Protection exists (Yes/No)	OTI Protection exists (Yes/No)	MOG with low oil level alarm exists (Yes/No)	SA exists (Yes/No)
1. Owner of Reactor : Assam, AEGCL										
1	400 kV Silchar - Azara (Mirza) line reactor of 63 MVAR at Azara (Mirza) end	Yes	Yes	Yes	Yes	Yes	Yes	Yes	Yes	Yes
2	Bus Reactor of 63 MVAR at Azara (Mirza)	Yes	Yes	Yes	Yes	Yes	Yes	Yes	Yes	Yes
3	Bus Reactor I & II of 12.5 MVAR at Mariani	REACTOR NOT IN OPERATION								
4	Bus Reactor I & II of 12.5 MVAR at Samaguri	REACTOR NOT IN OPERATION								
5	Bus Reactor I & II of 12.5 MVAR at Mariani	REACTOR NOT IN OPERATION								
2. Owner of Reactor/ Capacitor Bank : Meghalaya, MePTCL										
1	63 MVAR Bus Reactor at Killing (Byrnihat)									
2	132KV Capacitor Bank at Mawlai	No	No	Yes	Yes	No	No	No	No	Yes
3	132KV Capacitor Bank at EPIP I	No	No	Yes	Yes	No	No	No	No	Yes
4	132KV Capacitor Bank at EPIP II	No	No	Yes	Yes	No	No	No	No	Yes

Reactor Protection Details**Annexure II**

Sl. No.	Name of Line Reactor/ Bus Reactor/ Tertiary Reactor	Differential Protection exists (Yes/No)	REF Protection exists (Yes/No)	Definite Time Over Current Protection exists (Yes/No)	Earth Fault Protection exists (Yes/No)	Buchholz Operation exists (Yes/No)	WTI Protection exists (Yes/No)	OTI Protection exists (Yes/No)	MOG with low oil level alarm exists (Yes/No)	SA exists (Yes/No)

Note : 1. REF : Restricted Earth Fault, 2. WTI : Winding Temperature Indicator., 3. OTI : Oil Temperature Indicator)
4. MOG : Magnetic Oil Gauge, 5. SA : Surge Arrestor
6. List of inbuilt features of Numerical Relays are also to be furnished alongwith this format

Annexure II

Bus Bar & Local Breaker Backup(LBB) Protection Details				
Sl.No.	Name of Substation	Voltage level	Bus Bar Protection exists (Yes/No)	LBB Protection exists (Yes/No)
1. Owner of Bus Bar: MSPCL, Manipur				
1	Churachandpur	132 kV Bus Bar	No	No
		33 kV Bus Bar	No	No
2	Jiribam	132 kV Bus Bar	No	No
		33 kV Bus Bar	No	No
3	Kakching	132 kV Bus Bar	No	No
		33 kV Bus Bar	No	No
4	Karong	132 kV Bus Bar	No	No
		33 kV Bus Bar	No	No
5	Ningthoukong	132 kV Bus Bar	No	No
		33 kV Bus Bar	No	No
6	Rengpang	132 kV Bus Bar	No	No
		33 kV Bus Bar	No	No
7	Yaingangpokpi	132 kV Bus Bar	No	No
		33 kV Bus Bar	No	No
8	Yurembam.	132 kV Bus Bar	No	No
		33 kV Bus Bar	No	No
9	Kongba	132 kV Bus Bar	No	No
		33 kV Bus Bar	No	No
2. Owner of Bus Bar: MePTCL, Meghalaya				
1	Mawlai	132 kV Bus Bar	No	No
2	NEHU	132 kV Bus Bar	No	No
3	NEIGRIHMS	132 kV Bus Bar	No	No
4	Khliehriat	132 kV Bus Bar	No	No
5	Lumshnong	132 kV Bus Bar	No	No
6	Umiam	132 kV Bus Bar	No	No
7	Mawphlang	132 kV Bus Bar	No	No
8	Cherra	132 kV Bus Bar	No	No
9	Nongstoin	132 kV Bus Bar	No	No
10	Nangal	132 kV Bus Bar	No	No
11	Rongkhon	132 kV Bus Bar	No	No
12	EPIP-I	132 kV Bus Bar	No	No
13	EPIP-II	132 kV Bus Bar	No	No
14	Stage-I PH	132 kV Bus Bar	No	No
15	Stage-II PH	132 kV Bus Bar	No	No
16	Stage-III PH	132 kV Bus Bar	No	No
17	Stage-IV PH	132 kV Bus Bar	No	No
18	Umtru PH	132 kV Bus Bar	No	No
19	Leshka PH	132 kV Bus Bar	No	No

Bus Bar & Local Breaker Backup(LBB) Protection Details

Sl.No.	Name of Substation	Voltage level	Bus Bar Protection exists (Yes/No)	LBB Protection exists (Yes/No)
20	Killing	132 kV Bus Bar	Yes	No
		220 kV Bus Bar	Yes	No
3. Owner of Bus Bar: P&E, Mizoram				
1	Kolasib	132 kV Bus Bar	No	No
		66 kV Bus Bar	No	No
		33 kV Bus Bar	No	No
2	Luangmual	132 kV Bus Bar	No	No
		33 kV Bus Bar	No	No
3	Lunglei	132 kV Bus Bar	No	No
		33 kV Bus Bar	No	No
4	Serchip	132 kV Bus Bar	No	No
		33 kV Bus Bar	No	No
5	Saitul	132 kV Bus Bar	No	No
		33 kV Bus Bar	No	No
6	Zemabawk	132 kV Bus Bar	No	No
		33 kV Bus Bar	No	No
7	Bairabi	132 kV Bus Bar	Yes (EM)	No
		33 kV Bus Bar	No	No
8	Khawzawl	132 kV Bus Bar	No	No
		33 kV Bus Bar	No	No
4. Owner of Bus Bar: NEEPCO				
1	Ranganadi	400 kV Bus Bar	Yes	Yes
		132 kV Bus Bar	Yes	Yes
2	AGBPP	220 kV Bus Bar	Yes	Yes
3	AGTPP	132 kV Bus Bar	Yes	Yes
5. Owner of Bus Bar: NHPC				
1	Loktak	132 kV Bus Bar	Yes	Yes
6. Owner of Bus Bar: POWEWRGRID				
1	Aizawl	132 kV Bus Bar	Yes	Yes
2	Badarpur	132 kV Bus Bar		Yes
3	Balipara	400 kV Bus Bar	Yes	Yes
		220 kV Bus Bar	Yes	Yes
4	Bongaigaon	400 kV Bus Bar	Yes	Yes
5	Biswanath Chariali			
6	Dimapur	220 kV Bus Bar	Yes	Yes
		132 kV Bus Bar		Yes
7	Haflong	132 kV Bus Bar		Yes
8	Imphal	132 kV Bus Bar		Yes
9	Jiribam	132 kV Bus Bar		Yes
10	Khliehriat	132 kV Bus Bar		Yes
11	Kumarghat	132 kV Bus Bar		Yes
12	Mariani	220 kV Bus Bar	Yes	Yes
13	Melriat	132 kV Bus Bar		

Bus Bar & Local Breaker Backup(LBB) Protection Details

Sl.No.	Name of Substation	Voltage level	Bus Bar Protection exists (Yes/No)	LBB Protection exists (Yes/No)
14	Misa	400 kV Bus Bar	Yes	Yes
		220 kV Bus Bar	Yes	Yes
15	Mokokchung	220 kV Bus Bar		
		132 kV Bus Bar		
16	Namsai	132 kV Bus Bar		
17	Nirjuli	132 kV Bus Bar		Yes
18	Roing	132 kV Bus Bar		
19	Salakati	220 kV Bus Bar	Yes	Yes
20	Silchar	400 kV Bus Bar	Yes	Yes
		132 kV Bus Bar	Yes	Yes
21	Tezu	132 kV Bus Bar		
22	Ziro	132kV Bus Bar		Yes

Annexure -A.9 (II)

Bus Coupler Protection Details

Sl.No.	Name of Substation	Voltage level	Non directional O/C Protection exists (Yes/No)	Non directional E/F Protection exists (Yes/No)
1. Owner of Bus Coupler: MSPCL, Manipur				
1	Churachandpur	132 kV Bus Coupler	No	No
		33 kV Bus Coupler	No	No
2	Jiribam	132 kV Bus Coupler	No	No
		33 kV Bus Coupler	No	No
3	Kakching	132 kV Bus Coupler	No	No
		33 kV Bus Coupler	No	No
4	Karong	132 kV Bus Coupler	No	No
		33 kV Bus Coupler	No	No
5	Ningthoukong	132 kV Bus Coupler	No	No
		33 kV Bus Coupler	No	No
6	Rengpang	132 kV Bus Coupler	No	No
		33 kV Bus Coupler	No	No
7	Yaingangpokpi	132 kV Bus Coupler	No	No
		33 kV Bus Coupler	No	No
8	Yurembam.	132 kV Bus Coupler	No	No
		33 kV Bus Coupler	No	No
9	Kongba	132 kV Bus Coupler	No	No
		33 kV Bus Coupler	No	No
2. Owner of Bus Coupler: MePTCL, Meghalaya				
1	Mawlai	132 kV Bus Coupler	No	No
2	NEHU	132 kV Bus Coupler	Yes	Yes
3	NEIGRIHMS	132 kV Bus Coupler	No	No
4	Khliehriat	132 kV Bus Coupler	No	No
5	Lumshnong	132 kV Bus Coupler	No	No
6	Umiam	132 kV Bus Coupler	No	No
7	Mawphlang	132 kV Bus Coupler	Yes	Yes
8	Cherra	132 kV Bus Coupler	No	No
9	Nongstoin	132 kV Bus Coupler	No	No
10	Nangal	132 kV Bus Coupler	No	No
11	Rongkhon	132 kV Bus Coupler	No	No
12	EPIP-I	132 kV Bus Coupler	No	No
13	EPIP-II	132 kV Bus Coupler	No	No
14	Stage-I PH	132 kV Bus Coupler	Yes	Yes
15	Stage-II PH	132 kV Bus Coupler	Yes	Yes
16	Stage-III PH	132 kV Bus Coupler	Yes	Yes
17	Stage-IV PH	132 kV Bus Coupler	Yes	Yes
18	Umtru PH	132 kV Bus Coupler	No	No

Bus Coupler Protection Details

Sl.No.	Name of Substation	Voltage level	Non directional O/C Protection exists (Yes/No)	Non directional E/F Protection exists (Yes/No)
19	Leshka PH	132 kV Bus Coupler	Yes	Yes
20	Killing	132 kV Bus Coupler	Yes	Yes
		220 kV Bus Coupler	Yes	Yes
3. Owner of Bus Coupler: P&E, Mizoram				
1	Kolasib	132 kV Bus Coupler	Yes	Yes
		66 kV Bus Coupler	No	No
		33 kV Bus Coupler	No	No
2	Luangmual	132 kV Bus Coupler	No	No
		33 kV Bus Coupler	No	No
3	Lunglei	132 kV Bus Coupler	Yes	Yes
		33 kV Bus Coupler	No	No
4	Serchip	132 kV Bus Coupler	Yes	Yes
		33 kV Bus Coupler	No	No
5	Saitul	132 kV Bus Coupler	No	No
		33 kV Bus Coupler	No	No
6	Zemabawk	132 kV Bus Coupler	No	No
		33 kV Bus Coupler	No	No
7	Bairabi	132 kV Bus Coupler	No	No
		33 kV Bus Coupler	No	No
8	Khawzawl	132 kV Bus Coupler	No	No
		33 kV Bus Coupler	No	No
4. Owner of Bus Coupler: NEEPCO				
1	Ranganadi	400 kV Bus Coupler	Buscoupler Backup Protection (50/51A,B,C)	Buscoupler Backup Protection (50/51N)
		132 kV Bus Coupler	Directional O/C Protection	Directional E/F Protection
2	AGBPP	220 kV Bus Bar	Yes	Yes
3	AGTPP	132 kV Bus Bar	Yes	Yes
5. Owner of Bus Coupler: NHPC				
1	Loktak	132 kV Bus Coupler	Yes	Yes